

Emirates Hills PA-19 Development - Golf Towers III site 34 (The Views) (ش.م.س. دبي للمقاولات (ش.م.س. دبي) CSHK DUBAI CONTRACTING (L.L.C.)

**TRANSMITTAL FORM**

TRANSMITTER: CSHK Dubai Contracting LLC  
 PROJECT NO.: G70770  
 TO: HBBB  
 SUBJECT: HVAC System Equipment

ITEM	QTY	REV. SPEC. OR REV. REF.	DOCUMENT/REV. NO.	DESCRIPTION	TYPE	DATE	STATUS
1	2		G7170-MS-R-045	PRE-QUALIFICATION OF SPECIALIST FOR TESTING AND COMMISSIONING OF HVAC SYSTEMS	MD,OT		A

RECEIVED 13 DEC 2007

FOR SENIOR PROJECT MANAGER: [Signature] DATE: 13/12/07

FOR PROJECT MANAGER: [Signature] DATE: 13/12/07

ENGINEER'S COMMENTS: **ACTUAL (A) - REVIEWED**  
**UPDATED 15 DEC 2007**

Rec'd by: [Signature] 20 NOV 2007

THE VIEWS

Handwritten notes: "for confirm and proceed"

Project:- Golf Tower- III  
 Client: - M/s.Emmar  
 Consultant: - M/s.Noor  
 Main Contractor: - M/s.CSHK Dubai Cont.LLC  
 Hvac Contractor: - M/s.Elemec Electro Mech co

**ARCHGROUP**

**DOCUMENT TRANSMITTAL/APPROVAL REQUEST**

PROJECT: PROPOSED 2B+GR+24 STOREY COMMERCIAL & OFFICE BUILDING AT PLOT C-008-01C, DMC

CLIENT: H.H. SHEIKH AHMED BIN SAIED AL MAKTUM Ref: EJA/DS/MEP048

ISSUED TO: ARCHGROUP Date: 03/01/2008

MAIN CONTRACTOR: ASCON

PROJECT MANAGER (ARCHG): K.V.Shreenivas MEP Co-ordinator  
 MEPA Contractor: [Signature]

PLEASE FIND THE ENCLOSED DOCUMENTS WITH REGARD TO:  
 HVAC SYSTEMS TESTING AND COMMISSIONING PREQUALIFICATION MANUAL  
 NAME OF SUBCONTRACTOR - PRIME TECHNOLOGIES LLC.

For  Approval  INFORMATION  Others

CONSULTANT'S COMMENTS (For ArchGroup's use):  
 1) Refer comments on attached sheet  
 2) The Staff allocated for the project shall be limited as an information that for an review appears

Approved  Not Approved  
 Approved As Noted  Revise & Resubmit

Signature: [Signature] Date: 23/01/08  
 Name: K.V. Shreenivas

Note: Documents rejected must be resubmitted for approval, Contractor remain fully responsible for the contents for the approved documents under the Terms and Conditions of the Contract.

RECEIVED 23 JAN 2008  
 RECEIVED 06 JAN 2008

Handwritten notes: "for confirm and proceed"

Project:-2B+GR+24Comm&Office Building  
 Client: - H.H.Sheikh Ahmed bin Saeed Al Maktoum  
 Consultant: - M/s.Arch Group  
 Main Contractor: - M/s. ASCON  
 Hvac Contractor :- M/S. ETA

PROJECT: DUBAI INTERNATIONAL AIRPORT EXPANSION (PHASE II)  
AX443A-New EK Lounges C.1- MEP WORKS

MATERIAL SUBMITTAL: COMMENTS ON HVAC SUBCONTRACTOR T & C

Ref. No.: MS-MH-001- REV. 00 Date: 19 Mar .07

Project: - Dubai International Airport Expansion  
PH-III

Client: - DCA

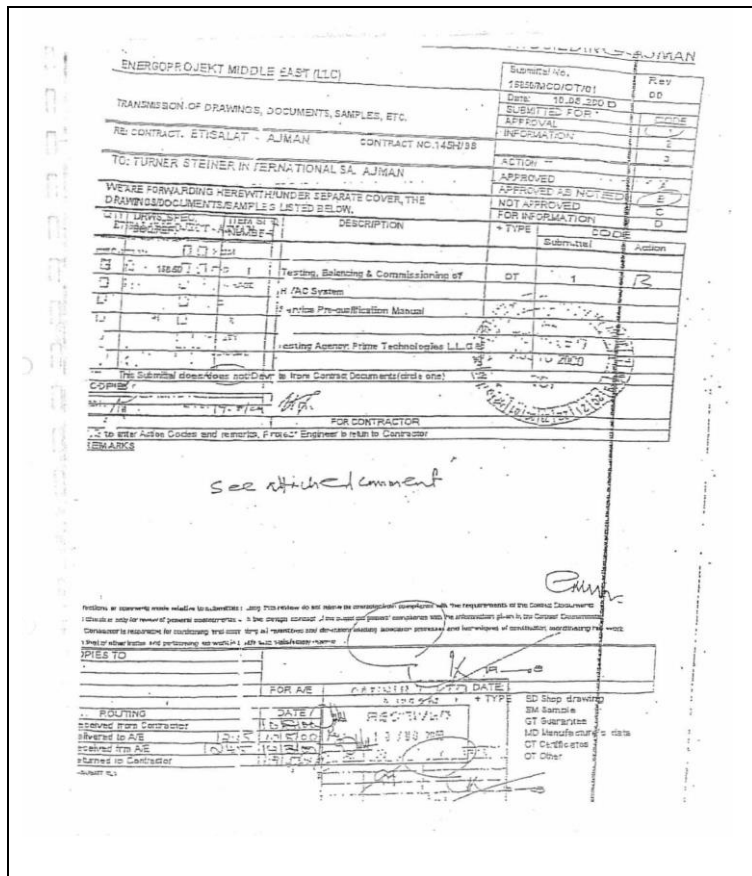
Consultant: - M/s.DAR AL HANDASAH

Main Contractor: - M/s. Masood Contg. LLC

Hvac Contractor: - M/s. ETA MHI Division

M/S PRIME TECHNOLOGIES (Dubai) is accepted provided the following:

- 1) It should be noted that testing and commissioning is taking place when the building is still not occupied. This must be taken into account especially during the final noise and temperature scans.
- 2) The submitted measuring devices are accepted. Yet, other devices are needed such as, pitot tubes, clamp-on ammeter with voltage scales, different types of anemometers, digital/glass thermometers and sling psychrometer.
- 3) Submit compliance statement where an activity is to be performed by the Contractor or a supplier instead of the Subcontractor. This statement is acceptable if the submittal; along with all its documents including the compliance statement is submitted by the Main Contractor, not the Subcontractor, and they are solely responsible for it.
- 4) Any rectification required by the testing balancing and commissioning Subcontractor shall be done at no extra cost.
- 5) The submitted forms shall include all the measurements to be taken and their expected values with upper and lower limits or error percentages if applicable.



ENERGOPROJEKT MIDDLE EAST (LLC)

TRANSMISSION OF DRAWINGS, DOCUMENTS, SAMPLES, ETC.

RE: CONTRACT: ETISALAT - AJMAN CONTRACT NO.148498

TC: TURNER STEINER INTERNATIONAL SA, AJMAN

WE ARE FORWARDING HERewith UNDER SEPARATE COVER, THE DRAWINGS/DOCUMENTS/SAMPLES LISTED BELOW.

ITEM NO.	DESCRIPTION	ACTION	APPROVED AS NOTICED	NOT APPROVED	FOR INFORMATION
1	Testing, Balancing & Commissioning of HVAC System	DT	1		
2	HVAC Pre-qualification Manual				

FOR CONTRACTOR

see attached comment

ROUTING

Approved from Contractor: [Signature]

Checked by AE: [Signature]

Approved from AE: [Signature]

Checked by Contractor: [Signature]

Project: - Etisalat Telecom & Administration  
Build-Ajman

Client: - M/s.Etisalat

Consultant: - M/s.Cansult

Main Contractor: - M/s.Energoprojekt

Hvac Contractor: - M/s.Energoprojekt

(Signature of M. Saheb)

**RMJM** PJ - 5100 DUBAI CONVENTION CENTRE  
 Project Site Offices  
 P. O. Box 6126  
 Dubai  
 Tel: + 9714 3329008  
 Fax: + 9714 3329007  
 e-mail: mirmjmc@emirates.net.ae

Submission Ref: KCE/MS/ETA/MA/041  
 Sheet No. 516 REV.0  
 SM9422

Date: 29.06.02 Convention Centre Carpark & Concourse  
 Dated: 30.06.02 Contractor KCE

**Submittal Description**  
 Planning and Commissioning Agency: **KHANSABE CIVIL ENGINEERING LLC**  
 KES 01 - DUBAI CONVENTION CENTRE

**Review Comments**

Approved subject to comments as attached

For RMJM: \_\_\_\_\_ Date: 30.6.02

**Status Awarded** See notes below

Status  A No objection proceed as submitted  
 Status  B No objection subject to comments being incorporated  
 Status  C Rejected - Resubmit

award of ANY Status does not, in any way, relieve the Contractor of his obligations and responsibilities under terms of his Contract. Nor does it imply, in any way, any additional payment or extension of time

TC: Comments (if any) Dubai 2003; Comments (if any)

**RECEIVED**  
 ETA - DCC - CO:  
 08 JUL 2002  
 Received by: [Signature] 6/17/02  
 Signed: [Signature] 3/1/02

Method Statement submitted by different supplier/contractor applied as per AL. The existing system etc. are being reviewed and comments to be provided by the project manager.

Project: - Dubai Convention Centre

Client: - M/s. Dubai Municipality

Consultant: - M/s. RMJM

Main Contractor: - M/s. Khan Saheb

Hvac Contractor: - M/s. ETA

10 Jun '00 14:13:00

Mr. Krishna Prakash A1

Project Title: AL QUOZ INDUSTRIAL DEVELOPMENT  
 Client: M/s. ENGINEER'S OFFICE  
 Management: M/s. ENGINEER'S OFFICE  
 Consultant: M/s. ENGINEER'S OFFICE  
 Contractor: M/s. DUBAI CONTRACTING COMPANY/ETA(MEP)

Project No: 6209  
 Site Location: AL-QUOZ-P1  
 Facility Code: M

**APPLICATION FOR APPROVAL**

Document Reference: T & C-001  
 Revision: 0  
 Date: 23/3/00  
 Sheet No: 1 OF 1

**CONTRACTOR'S APPROVAL**

APPLICATION FOR APPROVAL OF:  
 DESIGN  
 DRAWING  
 PREQUALIFICATION DOC  
 QA/QC STATEMENT (M.S.)  
 MATERIALS  
 EQUIPMENT  
 SAMPLE  
 TEST REPORT  
 OTHER

**TITLE & DESCRIPTION**  
 EXTERNAL TESTING AND COMMISSIONING AGENCY  
 PRE QUALIFICATION DOCUMENT

**LOCATION**  
 SOURCE DETAIL  
 ORIGINATED BY: PRIME TECHNOLOGIES  
 SUPPLIED BY: [Signature]  
 INSTALLED BY: ETAMEP CONTRACTOR

**CONTRACTORS ATTESTATION**  
 CONFIRMS TO SPECIFICATIONS  
 CONSIDERED TO BE EQUAL OR BETTER THAN SPECIFIED  
 REASON FOR ATTESTATION

**RECEIVED**  
 29 MAR 2000  
 DCC DUBAI

**REFERENCE TO THE CONTRACT DOCUMENT**  
 B.O.Q ITEM NO. TENDER GEN. SPEC. VOL-3; BOOK - 2  
 GENERAL SPECIFICATION SECTION & CLAUSE  
 PARTICULAR SPECIFICATION SECTION & CLAUSE  
 DRAWING REFERENCE NO.  
 ROOM DATA SHEET REFERENCE

**PROVAL COMMENTS**

**STATUS**  
 APPROVED  
 APPROVED AS NOTED  
 NOT APPROVED

**COMMENTS**  
 ACTION: Approve At Commissioning Agency for HVAC system for this project.  
 SUBJECT DETAILED METHOD STATEMENT FOR THIS MATERIAL ED (RAY QC) commissioning form shall be completed by 20/06/00.  
 ALL INSTRUMENT SHALL BE CALIBRATED PROVED & RECALIBRATED.  
 ALL INSTRUMENT SHALL BE CALIBRATED PROVED & RECALIBRATED.  
 ALL INSTRUMENT SHALL BE CALIBRATED PROVED & RECALIBRATED.

**SCHEDULE**

NAME	DESIGNATION	COMPANY	SIGNATURE	DATE
PNP PANICKER	PROJECT MANAGER	DCC	[Signature]	23/3/00
[Signature]	PROJECT MANAGER	ET-MEP	[Signature]	23/3/00
[Signature]	PROJECT MANAGER	ET-MEP	[Signature]	23/3/00

Project: - Al Quoz Industrial Development

Client: - M/s. Engineer's Office

Consultant: - M/s. Engineer's Office

Main Contractor: - M/s. Dubai Contracting Company

Hvac Contractor: - M/s. ETA

Form No: 04-2696773

### MATERIAL APPROVAL FORM

INTRACT		EMPLOYER	Submittal Ref.
5066 INDOOR SPORTS HALLS		DUBAI MUNICIPALITY	
ENGINEER		CONTRACTOR	Emt:
Archon		S.S. LOOTAH	516102
Revision: ( ) Firm ( ) Second ( ) Third		Approval required before:	

Option	PREQUALIFICATION FOR AC COMMISSIONING	Location of Use:	Al Manara F.N.A. 2
Origin	PRIME TECHNOLOGY	Local Agent/Supplier:	Local
Spec Ref:		Specification Ref:	
BOQ Ref:		BOQ Ref:	
Proposed: <i>Prime Technology</i>			

#### LIST OF ATTACHMENTS TO THIS FORM

1. Technical Literature	2. Technical Literature
3. Manufacturer's Guarantee	4. Manufacturer's Guarantee
5. Manufacturer License	6. Manufacturer License
8. PREQUALIFICATION DOCUMENTS	

FOR CONSULTANT			FOR CLIENT		
APPROVED	APPROVED WITH COMMENTS	NOT APPROVED	APPROVED	APPROVED WITH COMMENTS	NOT APPROVED
YES	<p><i>to proposed Agency may be subject to client's terms. The site personnel to be used shall be of acceptable performance. Variation clause shall be named in actual data space enclosed on all drawings.</i></p>	NO	<p>Submit compliance statement of spec clauses 1.1B and 1.21.7 of "Inspection, Testing and Adjusting" and "Commissioning of Services" respectively.</p> <p>Submit the copies of calibration certificates of instruments used.</p> <p>Submit method statement sheets of testing &amp; commissioning of air services as per A.P.B 15.1.2 Codes.</p> <p>Submit test formats of Package A/C units.</p> <p>Submit DM Standard Test Formats.</p>	YES	<p>Submit compliance statement of spec clauses 1.1B and 1.21.7 of "Inspection, Testing and Adjusting" and "Commissioning of Services" respectively.</p> <p>Submit the copies of calibration certificates of instruments used.</p> <p>Submit method statement sheets of testing &amp; commissioning of air services as per A.P.B 15.1.2 Codes.</p> <p>Submit test formats of Package A/C units.</p> <p>Submit DM Standard Test Formats.</p>
DATE OF THE			DATE OF THE		
SIGNATURE & DATE OF RECEIPT BY THE ENGINEER			SIGNATURE & DATE OF RECEIPT BY THE CONTRACTOR		

Does not relieve either the consultant or the contractor from responsibilities under the consultancy agreement.

Project: - PJ-5060 Indoor Sports Hall

Client: - M/s.Dubai Municipality

Consultant: - M/s.Archon

Main Contractor: - M/s. S.S.Lootah

Hvac Contractor: - M/s. ETA – MHI

<b>CONSULT LTD.</b> <b>AL AIN</b> <b>RECEIVED</b> <b>13 APR 2000</b>	<b>SUBMITTAL RECEIVED</b> <b>18 APR 2000</b>									
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>FROM</th> <th>INFO</th> <th>ACTION</th> <th>REMARKS</th> </tr> <tr> <td>PRIME TECHNOLOGIES - DUBAI</td> <td>18 APR 2000</td> <td>18 APR 2000</td> <td></td> </tr> </table>			FROM	INFO	ACTION	REMARKS	PRIME TECHNOLOGIES - DUBAI	18 APR 2000	18 APR 2000	
FROM	INFO	ACTION	REMARKS							
PRIME TECHNOLOGIES - DUBAI	18 APR 2000	18 APR 2000								
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>DATE</th> <th>DESCRIPTION</th> <th>-TYPE</th> <th>CODE</th> </tr> <tr> <td>18 APR 2000</td> <td>PRIME TECHNOLOGIES - DUBAI</td> <td></td> <td></td> </tr> </table>			DATE	DESCRIPTION	-TYPE	CODE	18 APR 2000	PRIME TECHNOLOGIES - DUBAI		
DATE	DESCRIPTION	-TYPE	CODE							
18 APR 2000	PRIME TECHNOLOGIES - DUBAI									
<p><b>NOTES:</b></p> <p>SPECIAL PROVISIONS HAS DELETED THE EQUIPMENT FOR EMPLOYMENT OF PROFESSIONAL FIRM. HOWEVER THIS IS STILL BEING PROVIDED AS PER ENGINEER'S REQUEST.</p>										
<p>The Contractor (Client) does not include even Contract Documents in this list</p> <p>ETA - COVER ONLY</p> <p>SUBMITTAL FILE - EDC</p> <p>HD - ABU SHAB</p> <p>M &amp; E EDC - COVER ONLY</p>										
<p>Proposed Vendor is acceptable but the performance will on site will be subject to review during commissioning. Final acceptance of instruments shall be decided on site. In the statements, acceptance standards, forms &amp; formats shall be provided separate. Based on the above, the acceptance is with out further delay. Carry out commissioning as per the Contract Documents.</p>										
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>DATE</th> <th>ACTION</th> </tr> <tr> <td>18 APR 2000</td> <td></td> </tr> </table>			DATE	ACTION	18 APR 2000					
DATE	ACTION									
18 APR 2000										

Project: - Etisalat Telecomm & Administration  
Build-Al Ain

Client: - M/s.Etisalat

Consultant: - M/s.Cansult

Main Contractor: - M/s. Arabtec

Hvac Contractor: - M/s.ETA

**RECEIVED**  
28 APR 2001  
AHDC

RUWAIIS HOUSING COMPLEX EXTENSION  
PROJECT NO. 0211  
ADJUSTMENT NO. 0211004  
CONSTRUCTION OF SATISFACTORY  
TWO UNITS - SEE PLATS FOR DETAILS

**DRAWING/DOCUMENT TRANSMITTAL FORM**

FROM: AL HAMED DEVELOPMENT & CONSTRUCTION L.L.C.  
TO: AHDC

Document No.	Description	Rev.	Quantity	Approved/Issued For
RY-40	Systems, Testes & Commissioning Prevalibation	1	2	2

CONTRACTOR REVIEW CHECK LIST

THIS SUBMITTAL INTENDED FOR:

APPROVAL COMMENTS

FOR YOUR RECORD

FOR: AL HAMED DEVELOPMENT & CONSTRUCTION L.L.C.

Originator: **REHMAN DAWOOD** (Signature: *Rehman Dawood*)  
Date: 22/04/01

SAVED FOR: **SAMER SAEED** (Signature: *Samir Saad*)  
Date: 22/04/01

ENGINEER: **ALI YAFARI** (Signature: *Ali Yafari*)  
Date: 22/04/01

COMMENTS:

APPROVAL DATE: 22/04/01

APPROVED BY: *[Signature]* TITLE: PROJECT MANAGER

*PRIME TECHNOLOGIES ACCEPTED FOR PRE-COMMISSIONING AND COMMISSIONING OF HVAC SYSTEM*

*SUBMIT SEPARATELY A COMPLETE PROCEDURE FORMAT FOR COMMISSIONING HVAC SYSTEM IN ACCORDANCE TO CONTRACT SPECIFICATION AND CHARACTERISTICS TO THIS PAGE.*

Project: - Ruwais Housing Complex Extension  
Client: - M/s. Adnoc  
Consultant: - M/s.DMJM  
Main Contractor: - M/s.Al Hamed Developmt & Construction  
Hvac Contractor: - M/s. ETA

**RECEIVED**  
20 FEB 2001

FROM: ARABIAN CONSTRUCTION CO. L.L.C.  
BY: MILNE & NICHOLLS INT'L LTD.  
TRANSMISSION OF DRAWINGS, DOCUMENTS, SAMPLES, ETC AND COV. LISTS  
RE: Etisalat Telecommunication & Administration Building - Abu Dhabi

TO: TURNER STEINER INTERNATIONAL SA.

Submittal No. 15850/SSO.0/DC41 Rev. 5  
Date: 18-Feb-01

QTY.	DRAWINGS, SPEC. BO.	ITEM NO.	DESCRIPTION	TYPE	CODE	Action
5	15880		Pre-qualification Documents M/s. Prime Technologies - U.A.E. for conducting balancing of air and water systems.	OT	X1	D

Enclosed: C.V. of Mr. Mohammed Shafulah as a balancing Engineer (2 Pages)

**MAPCO L.L.C.**  
P/1252  
RECEIVED ON: 22 FEB 2001

**SHANKLAND & COX**

APPROVED AS NOTED

NOT APPROVED

*proved to be permanent available onsite ring all commissioning works and hot method's stationing forms, and tool equipment and calibration certificates of instruments made relative to submittals. during this review do not relieve the contractor's responsibility for compliance with the requirements of the Contract Documents.*

*is only for review of general conformance with the design concept of the project and does not constitute an approval of the contractor's design or construction methods or materials or workmanship.*

ROUTING:

NAME	DATE	SIGNATURE
SAVED FOR	20/02/01	<i>[Signature]</i>
FOR APPROVAL	20/02/01	<i>[Signature]</i>

DATE: 22 FEB 2001

Project: - Etisalat Telecomm & Administration Build-Abu Dhabi  
Client: - M/s.Etisalat  
Consultant: - M/s. Shankland & Cox  
Main Contractor: - M/s.Arabian Constn.co.LLC.  
Hvac Contractor: - M/s. MAPCO

**CONTRACTOR'S PROPOSAL**

APPLICATION FOR APPROVAL OF	DESIGN	STATEMENT (A/E)	EXAMPLE
	DRAWING	MATERIALS	TEST REPORT
	PREQUALIFICATION DOC.	EQUIPMENT	OTHER

TITLE & DESCRIPTION: **HVAC SYSTEM TESTING & COMMISSIONING**

LOCATION: **MAIN KITCHEN & PLUMB ROOM**

SOURCE DETAIL: **PRIME TECHNOLOGY**

SUPPLIED BY: **PRIME TECHNOLOGY**

INSTALLED BY: **MA**

CONTRACTOR'S ATTESTATION:

CONFORMS TO SPECIFICATIONS

CONSIDERED TO BE EQUAL OR BETTER THAN SPECIFIED

DATE: **14 JUL 2001**

RECEIVED

DATE BY WHICH RESPONSE IS REQUIRED: **11.07.01**

THE SPECIFIED

GENERAL SPECIFICATIONS SECTION & CLAUSE: **GENERAL**

CONTRACTOR'S APPROVAL/COMMENTS:

COMMENTS:

**SEE ATTACHED COMMENTS SHEET**

REVISIONS:

**1. APPROVED FOR DR/WATER SYSTEMS**

**2. APPROVED FOR MECHANICAL COMMISSIONING ENG TO UNDERTAKE COMMISSIONING OF ALL MAIN EQUIPMENT'S**

**3. FULLY TESTED WATER SYSTEMS**

**4. CHECK FOR LEAKAGES**

**5. ALL SYSTEMS TESTED TO BE OK**

SUBMITTAL SCHEDULE:

INITIATED BY	NAME	DESIGNATION	COMPANY	SIGNATURE	DATE
INITIATED BY	TM WINKER	PROJECT MANAGER	ARABTEC	EMU	17.01
REVIEWED BY	TKHAWAJA	PHB	PHB	TKH	17.01
APPROVED BY	SHAWKAT	SEN. MGR. EN	PHB	SHAWKAT	21.01
APPROVED SIGNATORY	PRIME	PHB	ED	PRIME	12.01

*(3) Subject to no additional cost and time.*

Project: Zabeel Palace Kitchen Redevelopment

Client: - M/s. Engineer's Office

Consultant: - M/s. Sharafi - PHB

Main Contractor: - M/s. Arabtec

Hvac Contractor: - M/s. ETA

**AL HABTOOR MURRAY & ROBERTS JOINT VENTURE**

APPENDIX 808, 802/8A  
June 1999

PROJECT NAME/TITLE: **MARINA MALL, ABU DHABI**

APPROVAL SUBMITTAL

PROJECT NO.: **ESG-12-8**

DATE OF SUBMITTAL: **12-11-01**

CONTRACTOR: **PRIME TECHNOLOGIES TESTING & COMMISSIONING DIV.**

DESCRIPTION:

**Pre-commissioning & Commissioning Procedures & Check List of following:**

(1) Air Conditioning System - Section 1 of 4

(2) Electrical System - Section 2 of 4

(3) Plumbing & Fire Fighting System - Section 3 of 4

REVISIONS:

**1. APPROVED**

RECEIVED FOR REVIEW BY: **13-NOV-01**

DATE: **13.11.2001**

SIGNATURE: **Janet Jacob**

APPROVAL STATUS:

APPROVED - APPROVED AS NOTED

APPROVED - APPROVED AS NOTED

APPROVED - REVISIONS REQUIRED

Project: - Marina Mall, Abu Dhabi

Client: - M/s. Abu Dhabi Int'l Marine Sports Club

Consultant: - M/s. Gibb Middle East

Main Contractor: - M/s. Al Habtoor Engineering & Murray Roberts JV

Hvac Contractor: - M/s. ETA

Minutes of MAEC Coordination Meeting No 17 continued (F263F2)

4	STC stated that they shall submit a coordinated false ceiling layout drawings showing the location of canopy lights of the Gate House	Action UTCC/STC
5	STC/TTE confirmed that they shall submit a draft of the operation & maintenance manual for each service by inserting blank sheets wherever documents were not available by 14 00 00 and requested MAEC to provide the standard formats of the same if it is available MAEC agreed to provide.	STC/TTE
6	TTE informed that they have appointed "Prime Technologies" as an independent agency for carrying out testing & commissioning of A/C works of the project. TTE confirmed the following. <ul style="list-style-type: none"> <li>Pre-qualification document of "Prime Technologies" was submitted and has been approved.</li> <li>All A/C drawings were submitted to "Prime Technologies" and they are waiting for their review and comment.</li> <li>All comments noted on the approved drawings will be incorporated</li> <li>All required test points for carrying the testing &amp; commissioning will be carried out in full coordination with "Prime Technologies".</li> </ul>	STC/TTE
7	STC/TTE informed that the testing & commissioning procedures of all systems that are included in the project were submitted for MAEC's review and comments	MAEC
8	Next Meeting shall be on Monday the 13 03,2000 at 12 00 hrs at the site office	INFO

Project:-New West Gate Facility - Jafza

Client: - M/s. Jafza

Consultant: - M/s. Mario & Associates

Main Contractor: - M/s. Wade Adams LLC

Hvac Contractor: - M/s. Technical Trading Establishment

2/3

**MARIO ASSOCIATES**  
MECHANICAL & ELECTRICAL ENGINEERING CONSULTANTS  
P.O.Box 6499; Dubai, United Arab Emirates  
Tel.: +971-4-343-1122; Fax +971-4-343-1144  
A Business partner of R.G. Vanderwall Engineers, Inc., Boston-Orlando-Washington DC, USA

**DOCUMENT TRANSMITTAL FORM**

To	MR. RAVI	From	VICKY MALKANI
Company	BADRI & BENSOUDA	Ref	MS/DTE/SE/28
Project	BEACH VILLA FOR H.H. RULER OF AJMAN	Date	25 <sup>th</sup> AUGUST 2003

We enclose the following documents for your:

Approval  Coordination  Action  Information



Review and onward submission to Contractor

Other:  **KINDLY REPAK THE TRANSMITTAL FORM**

DOCUMENT/ DRAWING REF. NO.	DESCRIPTION	NO. OF COPIES	STATUS
SHL/0222k3	CHW SYSTEM CLEANING AND CHEMICAL DOSING	1	A
ACS/24	PRE-QUALIFICATION OF PRIME TECHNOLOGIES FOR TESTING & COMMISSIONING OF HVAC SYSTEM	1	A

A: Reviewed with comments    R R: Reviewed with comments & requires resubmission    R: Rejected

Forwarded the above documents    Received the above documents

Name: VICKY MALKANI    Name:   
Signature:     Signature:    
Date: 25/8/03    Date: 26/8/03

Badri & Bensouda  
Architectural & Engineering  
Consultants  
Received on: 26/8/03

Project:-Beach Villa For H.H.Ruler of Ajman

Client: - H.H.Ruler of Ajman

Consultant: - M/s. Mario & Associates

Main Contractor: - M/s. Unique Contracting

Hvac Contractor: - M/s. Fawaz Air Conditioning

Client : ALI S. AL SHAHRI  
 Consultant : WS ATKINS & PARTNERS  
 ARABTEC (L.L.C.)

### SUB-CONTRACTOR / SUPPLIER APPROVAL REQUEST

(To be Attached to Contractors Request Letter)

Submittal No. : SAR-01.1.1, Rev.0  
 Submittal Date : 15.09.2003  
 Reply Required : 30.09.2003

Approval Requested For : M/s. PRIME TECHNOLOGIES LLC  
 FOR TESTING AND COMMISSIONING OF HVAC SYSTEM

Dear Sir,  
 Please find enclosed herewith 2(Two) sets of supporting documents pertaining to proposed Sub-contractor which includes the following:

- Name and Classification
- Details of Recent Performances
- Type, Number and Current Location of Plants
- Full List of Names, Qualifications and Experience of Staff (CV's)
- Detailed and Comprehensive Method Statement of Performance
- Safety and Quality Plan (Main Contractor's Safety and Quality Plan)
- Certificates / Licences from Relevant Authorities
- Additional Info as per attached Contractor Pre-qualification Info

Contractor's Project Manager : Omar Lababidi  
 Name Signature

Comments / Recommendation By Consultant :  
 I have checked the submitted organization and have found it to be a good one along with the name of the project. Making shall be arranged with the typical invoice and the cost of work shall be clearly defined.

APPROVED  APPROVED WITH COMMENTS  NOT APPROVED

Approval does not relieve the Contractor of his obligations under the Contract and he shall be liable for its, defaults and negligence by the Sub-contractor.

Signature: [Signature] Date: 21-0-04

Project:-Al Yamamah Residence Project 4432

Client: - M/s.Ali S. Al Shahri

Consultant: - M/s.WS. Atkins & Partners

Main Contractor: - M/s. Arabtec LLC

Hvac Contractor: - M/s. ETA

8 - MAR 2004

CONTRACTOR: ARCHON  
 EMPLOYER: H.H. Sheikh Ahmed Bin Saeed Al Maktoum  
 CONTRACTOR: Nasa Multiplex LLC

### SUBMITTAL FOR APPROVAL OF MATERIAL/EQUIPMENT

Item: 1. Heating, Balancing and Adjusting of HVAC systems (Prequalification)

Manufacturer: [Blank]  
 Origin: File Ref

Approval Required before: 15/03/2004

LIST OF ATTACHMENTS TO THIS FORM

1. Brochure/Catalogue	<input type="checkbox"/>	2. Method Statement	<input type="checkbox"/>
3. Sample	<input type="checkbox"/>	4. Product Literature	<input type="checkbox"/>
5. Manufacturer's License	<input type="checkbox"/>	6. Manufacturer's Guarantee	<input type="checkbox"/>
7. Test Results	<input type="checkbox"/>	8. Alternative Proposal	<input type="checkbox"/>
9. Manufacturer's License	<input type="checkbox"/>	10. Technical Data	<input checked="" type="checkbox"/>
11. Prequalification Documents	<input checked="" type="checkbox"/>	12. Other Attachment	<input type="checkbox"/>

FOR THE ENGINEER

Approval: Approved  Approved with Comments  Rejected

COMMISSIONING AGENCY TO ARRANGE INTERMITTENT VISITS TO THE SITE TO SUPERVISE ALL NECESSARY PROVISIONS ARE DONE FOR PRE-COMMISSIONING (COMMISSIONING DURING INSTALLATION) - ONLY QUALIFIED STAFF WITH RELEVANT HOTEL EXPERIENCE TO BE DEPUTED AT SITE (C.O.) TO BE SUBMITTED FOR REVIEW/ APPROVAL - ALL EQUIPMENT AND SERVICES TO BE RECOMMENDED / COMMUNICATED TO THE CONTRACTOR BY ENGINEER / CLIENT - BE COMMUNICATING AGENCY TO REVIEW ALL SHOP DRAWINGS AND CONTR. RESPONSIBILITY OF INSTALLATION FOR COMMISSIONING AND GET ANY MODIFICATION IF REQUIRED - CONTRACTOR TO COORDINATE WITH ALL RELATED AGENCIES FOR STARTS ELECTRICAL OR ENTIRE SYSTEM.

SIGNATURE AND DATE OF RECEIPT BY THE ENGINEER: [Signature] 27/3/04

SIGNATURE AND DATE OF RECEIPT BY CONTRACTOR: [Signature] 27/3/04

Project: - 3B+G+45Hotel & Service Apartments  
 Marsa,Dubai

Client: - H.H.S.Ahmed Bin Saeed Al Maktoum

Consultant: - M/s. Archon

Main Contractor: - M/s. Nasa Multiplex LLC

Hvac Contractor: - M/s. Bilt Middle Eas LLC



March 2003  
Page 22

**DOCUMENT REVIEW RECORD**

Form No. ....  
Previous Transmittal No. 251/PQR/ETA/02 Rev.0

PROJECT: ADCO Contract No. 5725.01/EC 10907  
CONSTRUCTION WORKS FOR BU HASA INFRASTRUCTURE UPGRADE PROJECT

DISCIPLINE: Airconditioning  
TRANSMITTAL No. 251/PQR/ETA/02 Rev.1

Reference Document / Specification :

Description of Document Under Review :

Document No. 251/PQR/ETA/08  
Prequalification Submittal for:-  
M/s. Prime Technologies  
For  
Testing and Commissioning

Enclosure: 1) ADCO Commented Copy  
2) ADCO Comments Clarification

Prepared by:  
NAME: MAZEN ABU KHAIT  
SIGNATURE: *[Signature]*  
DATE: 10/1/03

Checked by:  
NAME: *[Signature]*  
SIGNATURE: *[Signature]*  
DATE: 17.11.2003

A: Approved  
B: Approved as noted  
C: Revise as noted & Resubmit  
D: Rejected

Senior Construction Engineer (SCEH)  
Date: 18/1/03

**REMARKS**  
ACCEPTED

**H.E.E - 261**

DATE RECEIVED	14/1/03
REPLY	
FILE	
DIST.	
INFO.	
MA	
ETA	

**EMIRATI TRADE AUTHORITY**  
REG. NO. 123

Project: - Bu Hasa Infrastructure Upgrade

Client: - Adco

Consultant:-M/s. Associated Consulting Group

Main Contractor:-M/s. Al Habtoor Engineering

Hvac Contractor: - M/s. ETA – Abu Dhabi

**KHALEEJ TIMES-NEW PRINTING PRESS**

JK

**SUBCONTRACT SUBMISSION**

Consultant: BEL YOAHAH  
Contractor: AL NABOODAH LAING  
Contract Title: KHALEEJ TIMES NEW PRINTING PRESS

Submittal Ref. No. MS/ETA/MA/001 - Rev. 00  
Submittal Date: 01/04/03

DETAILS OF SUBMITTAL: HVAC MATERIAL

Subject of Submittal: Testing & Commissioning Agency

Manufacturer: Prime Technology  
Local Agent: M/s. Prime Technology

Urgent  Normal  Sample Attached  Info. Attached.

**APPROVAL**

Signature: *[Signature]*  
Date of Approval: 24/03/03  
Approval Subject to: *To follow procedure of testing & commissioning*

**REJECTION**

Signature: \_\_\_\_\_  
Reasons for Rejection: \_\_\_\_\_

Re-submittal Required:  Yes  No

Distribution: PM/QS/SITE FILE

AL NABOODAH LAING  
BEL YOAHAH CONSULTANTS

FROM DP/07/107  
msSub-Submission-AC42

Project: - Khaleej Times – New Printing Press

Client: - Galadari New Printing & Publishing Services

Consultant: - M/s. Bel Yoahah

Main Contractor: - M/s. Al Naboodah Laing

Hvac Contractor: - M/s. ETA

**SULTAN ABDUL RAHMAN CONTRACTING COMPANY**  
P.O. BOX 10213, DUBAI, U.A.E.  
TEL: 04-2747777 FAX: 04-274612 / 227360

LETTER OF TRANSMITTAL

TO: M/S SCHUSTER PECHTOLD & PARTNERS  
ATTENTION: MR. S. JOACHIM STOEHR  
PROJECT: ISMAIL AKHIL ABBASI

DATE: 27.08.02  
REF: SPP 904  
RE: 31 AUG 002

ENTLEMEN:

WE ARE SENDING YOU THE FOLLOWING ITEMS:

WITH  DELIVERED BY HAND  UNDER SEPARATE COVER

PLANS  PRINTS  SHOP DRAWINGS  SAMPLES  SPECIFICATIONS

ESTIMATES  COPY OF LETTER  COMMISSIONING PROCEDURES

COPIES	DATE OR NO.	DESCRIPTION
3 Sets of		Testing and Commissioning Procedures for A/C
1 Set of		Prequalification documents of Testing and Commissioning Contractors (MCB Bids) as submitted by M/s ETA (M/s) and Electrical Test Procedures (L1X) submitted by AT ITM P.O.
2 Sets of		Fire Alarm + Emergency Sign by AT ITM P.O.

THESE ARE TRANSMITTED AS INDICATED BELOW.

FOR YOUR USE:  APPROVED AS NOTED  RETURN  CORRECTED PRINTS

FOR APPROVAL  APPROVED FOR CONSTRUCTION  SUBMIT  COPIES FOR

AS REQUESTED  RETURNED FOR CORRECTIONS  RESUBMIT  COPIES FOR

FOR REVIEW AND COMMENT  RETURNED AFTER LOAN TO US  FOR BIDS ONLY

REMARKS: DEVELOP TEST SHEET FOR "FAHU'S" WITH HEAT EXCHANGERS / HEAT WHEELS - TO SHOW THE PERFORMANCE OF THE HEAT WHEELS ETC

APPROVED: [Signature]  
SUBJECT TO COMMENTS / REVISIONS

RECEIVED FOR: M/S SPP - NAME: [Signature]  
SIGNATURE: [Signature]  
SCHUSTER PECHTOLD AND PARTNERS

Project: - G+M+7 Residential Building, Dubai

Client: - Ismail Akhil Abbas

Consultant: - M/s. SPP

Main Contractor: - M/s. Saarco

Hvac Contractor: - M/s. ETA

FROM: SAUDI OGER EMIRATES LIMITED  
FRM NO: 10057124493587  
Jan. 31 2006 09:54PM P1

RECEIVED SAUDI OGER EMIRATES LIMITED  
PROJECT NO: P-13

QTY	DEPT. SPEC. OR BIDD SPEC.	ITEM NO.	DESCRIPTION	TYPE	REMARKS	DATE
3	12050	L110	PRE-QUALIFICATION DOCUMENTS FOR HVAC SYSTEM AIR & WATER BALANCING CONTRACTOR	OT	1	6

TO: ALJALAL PROJECTS PUBLIC SITE OFFICE

REMARKS: Consultant's Comments: Recommend approval for M/s Prime Technologies as Independent Agent for testing and commissioning of HVAC system signed to ICL Diabetes for M/s. Mubadala for the purpose to be duly authorized and responsible for the test. For M/s. Performance to be confirmed, Performance and all other related details as per relevant Code of practice.

PROJECT MANAGER COMMENTS: Refer to the consultant comments

SAUDI OGER EMIRATES ICL DIABETES CENTER

RECEIVED SAUDI OGER EMIRATES LIMITED

Project: - ICL Diabetes Centre

Client: - Mubadala

Consultant: - M/s. HDP (Overseas) Ltd

Main Contractor: - M/s. Saudi Oger Emirates Ltd

Hvac Contractor: - M/s. Mapco LLC

**SUBMITTAL COVER SHEET**

**JUMEIRAH BEACH RESIDENCE**  
**JBR - SECTOR 5**

Contract No: 5505  
 Contract Title: JBR5 Main Construction Contract  
 Contractor: Al Ahmadiyah Contracting & Trading

Submittal Type: Sub Contractor Approval Request  
 SCAR-00036  
 Revision No: 000  
 Submission Date: 01 Aug 2005  
 Discipline: MEP

Product Name: Testing & Commissioning Agency  
 Manufacturer: Prime Technology LLC, Dubai.

TO: WS Atkins & Partners

Description: Sub Contractor Approval Request for Testing & Commissioning Technologies LLC, P.O.Box 26736, Dubai, U.A.E attached.

Item No.	Description	Quantity	Unit	Remarks
1	Complete Pre-qualification of M/s Prime	1	Lot	✓
2	Complete Pre-qualification of M/s Prime	1	Lot	✓
3	Complete Pre-qualification of M/s Prime	1	Lot	✓
4	Complete Pre-qualification of M/s Prime	1	Lot	✓
5	Complete Pre-qualification of M/s Prime	1	Lot	✓
6	Complete Pre-qualification of M/s Prime	1	Lot	✓
7	Complete Pre-qualification of M/s Prime	1	Lot	✓
8	Complete Pre-qualification of M/s Prime	1	Lot	✓
9	Complete Pre-qualification of M/s Prime	1	Lot	✓
10	Complete Pre-qualification of M/s Prime	1	Lot	✓

1) Proposed agency is from the same sponsor as the MAE contractor - Not as per L01.  
 2) No technical objection to appointing Prime Technologies LLC for testing & commissioning of project including air & water balancing, all as per specification & contract requirements. Contractor shall submit following project specific documents:  
 a) CVs of proposed manpower.  
 b) Organisation structure proposed.  
 c) Site & backup staff proposed.  
 d) Formats of purpose made check lists, precommissioning sheets, air & water test plans & balancing sequence schedule & method statement as stated in the contract.

RECEIVED: 3 AUG 2005

APPROVAL STATUS: [ ] A Approved No Comments  
 [ ] B Approved As Noted  
 [ ] C Not Approved - Revise  
 [ ] R For Record Only

Contractor has reviewed this submission prior to submission to Consultant.

Signature: \_\_\_\_\_ Date: 11.08.05

Project General Manager: George Mitri  
 and on behalf of  
 Atkins & Partners

Mace International Ltd.  
 Dtd: \_\_\_\_\_ ETR: \_\_\_\_\_ 988 5P:91 988/28/51

Project : - JBR- Sector 5

Client: - Jumeirah Beach Residence

Consultant: - M/s. Ws Atkins & Parters

Main Contractor:-M/s.Al Ahmadiyah Cont.. & Trading

Hvac Contractor: - M/s. ETA

**Khatib & Alami**  
 consolidated engineering company

DU0367/DU/L/4571/06  
 22nd February 2006

M/s: Civilco Engineering & Contracting  
 P O Box 39970,  
 Dubai, UAE.

Attn: Mr. Muhannad Haddadin - Project Manager

Project: La Residencia Del Mar - Dubai Marina  
 Subject: Subcontractor  
 Testing & Commissioning Air Conditioning System

Dear Sir,

We refer to your letter ref. CD/100/MH/1240 dated 15 February 2006 and wish to advise you of the following:

- No objection for M/s. Prime Technology as commissioning subcontractor subject to approval of their method statement for commissioning the work.
- Kindly submit your Programme for commissioning.

Yours faithfully,  
 For **KHATIB & ALAMI**  
 consolidated engineering co.)

**MAHMOUD GHADBAN**  
 Engineer's Representative

Copy TO	Act.	Int.
MEP		
AM		
PM	✓	
Engineering	✓	
ME		
SE		
QS		
QA/QC		
MEP Coord	✓	
Architect		
Site Admin.		
Stores		
Plant	✓	
SAC I		
SAC II		

22/02/06

كاتب: 221014 P.O. Box 5091 DUBAI E-Mail - info@kcaubai.ae  
 هاتف: 5722224 P.O. Box 698 SHARJAH E-Mail - info@kaccuae.com  
 فاكس: 8660289 P.O. Box 2732 ABU DHABI E-Mail - bxl@emirates.net.ae  
 فاكس: 7281080 P.O. Box 18763 AL AIN  
 هاتف: 5591798 P.O. Box 87991 DUBAI





Project: - La Residencia Del Mar Dubai Marina

Client: - Mr.Seyed Mohammed Ata Shobeiry

Consultant: - M/s. Khatib & Alami

Main Contractor: - M/s. Civilco Engineering

Hvac Contractor: - M/s. Civilco Engineering

		<b>Material Approval</b> REF. NO : MS-ETA-AC-32			
COMMERCIAL / RESIDENTIAL BLDG FOR KHALID AL GHURAIR - PORT SAIED-PLOT NO 129-1B2 To: M/s. FRASER & NAG PARTNERSHIP					
<b>Material Description</b> (One item only per form)		Prequalification for Testing & Commissioning		As Specification <input checked="" type="checkbox"/> Alternative <input type="checkbox"/>	
Drawing Ref. : A/C & Ventilation layouts		B.O.Q. Ref. No. : -			
Specification Ref. :		Standards : -			
(Attach all relevant technical literature marked to identify relevant descriptions, current test certificate, samples etc.)					
List of attached documents: 1) Scope of Work 2) Prequalification Manual from the supplier					
<b>MANUFACTURER / SUPPLIER</b>					
Company Name : Prime Technologies		Country of Origin : Availability		Local On Order	
Address : P.O. Box-26736 Dubai, U.A.E		Production Period Delivery Ex-Works Total delivery time			
Local Agent : Same As Above		Overland Sea Freight Total Freight			
PROGRAMME : Date material required on site Expected date of arrival on site					
Contractor's signature : 		Date : 22.07.06			
<b>Engineer's Comments</b>  <i>Work may proceed</i> <i>for IBA</i> <i>25/7/06</i>					
Copy to: M/s IBA Copies: 1+2		<b>SUBMITTAL STATUS:</b> <input checked="" type="checkbox"/> WORK MAY PROCEED <input type="checkbox"/> REVISE AND RESUBMIT WORK MAY PROCEED SUBJECT TO INCORPORATION OF CHANGES INDICATED <input type="checkbox"/> REVISE AND RESUBMIT WORK MAY NOT PROCEED <input type="checkbox"/> REVIEW NOT REQUIRED WORK MAY PROCEED			
IMPORTANT: Permission to proceed does not constitute acceptance or approval of design details, calculations, analysis, test methods or materials developed or selected by the supplier or contractor and does not relieve the supplier or contractor from full compliance with contractual obligations in respect of meeting the specifications and contract document requirements.					
SIGN (P/MP) : _____ DATE : _____ SIGN (P/UCP) : _____ DATE : _____ SIGN (IBA) : _____ DATE : 25/7/06					

Project: - Comm/Resid Building For Khalid Al Ghurair  
 Client: - Khalid Al Ghurair  
 Consultant: - M/s. The Fraser Nag Partnership  
 Main Contractor: - M/s. Ascon  
 Hvac Contractor: - M/s. ETA

		ARCHITECTURAL & ENGINEERING CONSULTANTS TECHNICAL SUBMITTAL REVIEW FORM - MATERIAL - MECHANICAL		Form # CE-005 REV. 0 Page # 1 / 1				
PROJECT NAME : Ministry of Foreign Affairs		CLIENT'S PROJECT No. : 451						
AEC PROJECT No. : SIX CONSTRUCT LIMITED		CONTRACTOR : 1-Nov-04 DUR. 21 M						
<b>CONTRACTOR'S NUMBERING AND IDENTIFICATION</b>								
SUB. No.	REV.	DISCIPLINE	CONTRACTOR'S DOCUMENT CONTROL REF.	SUBMITTAL DATE	TRANSMIT. No.	TRANSMIT. DATE		
MEC-0193		MECHANICAL	T H A C GEN 1 0 0 1 5	13-Nov-05	3 0 4 7	13-Nov-05		
<b>AEC - SUBMITTAL NUMBERING AND IDENTIFICATION</b>								
SUB. No.	REV.	DEVISION	DIV. No.	SECTION No.	BUILDING	ACTIVITY DESCRIPTION	DATE RECEIVED	
MEC-0193		MECHANICAL	15	15950	All	Pre qualification document of M/s. Prime technologies for HVAC Testing & Commissioning	13-Nov-05	
<b>SUBMITTAL PLANNED</b>		<b>ACTUAL</b>		<b>REVIEW PLANNED</b>		<b>ACTUAL</b>		
EARLY FINISH	FLOAT	LATE FINISH	SUBMITTED	EARLY FINISH	FLOAT	LATE FINISH	EARLIEST FINAL ACTION	
-	-	-	13-Nov-05	-	-	-	4-Dec-05	
<b>SUBMITTAL DESCRIPTION</b>								
SUBMITTAL DESCRIPTION : Pre qualification document of M/s. Prime technologies for HVAC testing & Commissioning		MATERIAL DESCRIPTION : N/A		PRODUCT NAME : -		MANUFACTURER : -		
DOCUMENT / ENOUGH FOR EVALUATION : Yes Yes								
<b>COMMENT ON SUBMITTAL</b>		* Contractor submitted Pre qualification document of M/S. PRIME TECHNOLOGIES (HVAC Testing & Commissioning) a 3rd party agency which is required for testing and commissioning as per specification 15950. * Specification calls for at least 10 years continuous business in the testing & balancing field where as this agency is established only in 1998.						
Please use extra sheet if space above is not adequate								
<b>CONTRACT DOCUMENTS RELATED TO SUBMITTAL</b>								
SUBJECT	DRAWINGS			SPECIFICATIONS			BOQ	SUBJ. QTY
	Discipline	DWG No.	REV.	Vol.	Part	DIV		
Testing & Commissioning	Mechanical	HVAC	-	-	15	15950	1	to 14
<b>AEC APPROVAL ACTION</b>								
<input checked="" type="checkbox"/> Approved with Comments <input type="checkbox"/> Revise & Resubmit <input type="checkbox"/> Rejected								
<b>REVIEW COMMENTS</b>		* Proposed 3rd party Testing & Commissioning Agency M/S. PRIME TECHNOLOGIES, experience is less than specified. However considering the type of Projects they handled, which are detailed in the Pre qualification Manual, they are acceptable as a 3rd party Testing & commissioning Agency, subject to the following. * Clause by Clause compliance statement with reference to the Specification 15950 to be submitted. * Test procedures, Schematic showing Test Points, Test Formats with Design Values etc to be submitted.						
<b>AEC ENGINEER</b>				<b>AEC RE</b>				
NAME : T.K. Abdul Majeed		NAME : Nabil S. Mabrouk		TITLE : Mechanical Engineer		TITLE : Senior Resident Engineer		
DATE : 4/12/2005		DATE : 4/12/2005		SIGNATURE :		SIGNATURE :		

Project: - Ministry Of Foreign Affairs  
 Client: - Emirates Of Abu Dhabi  
 Consultant: - M/s. Architectural & Engineering Consultants  
 Main Contractor: - M/s. Six Construct Ltd  
 Hvac Contractor: - M/s. Thermo LLC

**DOCUMENT SUBMITTAL FORM (DSF)**  
 Date: 6-Oct-12  
 Project: SHEMOUKH TWIN TOWER-ALSAAD  
 Subject: Method Statement for Air and Water Balancing

Trans. Ref: [ ] Rev. No. [ ] FROM: SEG- Qatar

TO: Project Manager, HHI International

REVISIONS: [ ] Inspection and Test [ ] Test Report [ ] Method of Statement [ ] Others

DISCIPLINE: [ ] Civil/Structural [ ] Architectural [ ] Electrical [ ] Mechanical [ ] Others

Contractor's review note prior to submission:  
 Remarks: We certify that the above submitted documents have been reviewed in detail and are correct and in strict conformity with the contract drawings specifications except as otherwise stated.  
 Attached (4 sets)  
 Accepted and Approved by: [Signature] Project Manager (Signature)

Consultant's review comments: \*Approval Status\* B  
 Comments & Remarks on above submission:  
 SEE OUR COMMENTS AS PER ATTACHED  
 Approved as noted  
 Reviewed by: [Signature] Project Manager (Signature)

Legends: [ ] Approved [ ] Approved as Noted [ ] C.Revise and Resubmit [ ] D Rejected [ ] Submission Incomplete/Resubmit

FOR THE CONTRACTOR:  
 We retain herewith one set of submittal marked with comments and action code. The approval shall not relieve the Contractor of its obligations and liabilities under the contract or constitute authorization of any change to contract documents and therefore shall not imply any recognition whatsoever of additional time or cost to the contract.

Project Manager's (Comments, if any):  
 Comments & Remarks on above submission:  
 Reviewed by: [Signature] Project Manager (Signature)

Copy Distribution & Received by: [Table]

Forwarded to Consultant: [Stamp: 06 OCT 2012 RECEIVED]

Submitted to PM: [Stamp: 06 OCT 2012 RECEIVED]

Forwarded to Contractor: [Stamp: 13 OCT 2012 RECEIVED]

BY: [Signature] TIME: [Signature]

Document No. DSF-Rev-01

- JN Prime Technology / QC  
 - Engineer Received 14/10/12 - 0.11.02

Project: - Al Shemoukh Twin Tower-Qatar  
 Client: - M/s.Real State Services Group – Qatar  
 Consultant: - M/s. Ehaf Consulting Engineers  
 Main Contractor: - M/s. SEG  
 Hvac Contractor:-M/s.Arabian MEP Contracting

**Dubai World Central International Airport**  
 DLC HEADQUARTERS & OFFICE PARK

Contract Ref: JXBI/BLD/410  
 SUBCONTRACTOR APPROVAL REQUEST  
 SCA No : 0038 Rev 04 /

Contract: Phase 1  
 To the Engineer: DAR AL HANDASAH Date: 30.01.2010

Approval request for: PRIME TECHNOLOGIES LLC  
 Description of work to be subcontractor: FOR TESTING AND COMMISSIONING OF HVAC SYSTEM

Dear Sir,  
 Please find enclosed herewith supporting document pertaining to proposed subcontractor which includes the following

- Name and classification [ ]
- Details of recent performances [ ]
- Type, Number and current location of plants to deployed on this project [ ]
- Full list of names, Qualifications and Experience of Staff [ ]
- Outline method statement of performance [ ]
- Written confirmation that he will Act and Comply in full conformity with the contract and the main contract's construction Program [ ]
- Certificates/ Licences from relevant authorities. [ ]

Contractor's Authorized Signature: [Signature] Contractor's QMS Manager: [Signature]

Engineer's Comments :-  
 (An approval does not relieve the Contractor of his obligation under the contract and he will be Liable for all acts, Defaults and negligence by the subcontractor)  
 This approval is granted subject to Prime Technologies' complying with contract's requirements in this regard, and is granted.

Signed (Resident Engineer): [Signature] 13/02/10

MA. KHARAFI & SONS  
 SCA No. 0038 Rev 04 /

Status: Code 1 (Work may proceed) Code 2 (Review & Resubmit) Code 3 (Review & Resubmit) Code 4 (Review not required)

Chief Resident Engineer: [Signature] Date: 13 FEB 2010

CC: DCA TTS [Stamp: 14 FEB 2010 RECEIVED] [Stamp: 13 FEB 2010 RECEIVED]

Code 1 - Work may proceed  
 Code 2 - Review & Resubmit. Work may proceed, subject to incorporation of comments. Important: Permission to proceed does not relieve contractor from full compliance with contractual obligations.  
 Code 3 - Review & Resubmit. Work may not proceed.  
 Code 4 - Work may proceed.

Project: - DLC Headquarters & Office Park  
 Client:- M/s.Department Of Civil Aviation Dubai  
 Consultant: - M/s. Dar Al Handasah  
 Main Contractor: - M/s. M. A. Kharafi & Sons  
 Hvac Contractor: - M/s. ETA MNE

**Document Transmittal Form**

Record Reference: **ASEM-AC-06-Rev-09-AL Zakhar & AL Eoaa** Date: 19/11/2012  
 Musanada's Project Number: 52340-C1439 & 52340-C1440

**Project Details:**  
 Project Name: Abu Dhabi Future School Program Phase-3, Package 4  
 Client: Abu Dhabi Education Council  
 The Engineer: KEO International Consultant  
 Trans No: 52340-C1439/11/01/103/12 Rev No: 0

**Subject: TESTING & COMMISSIONING DOCUMENTS FOR AIR BALANCING AND WATER BALANCING OF HVAC SYSTEMS - 3<sup>rd</sup> PARTY INDEPENDENT AGENT**

Type: (Tick Applicable)	<input type="checkbox"/> Technical Data	<input type="checkbox"/> Guarantee	<input type="checkbox"/> Certificate	<input type="checkbox"/> Test Result
	<input type="checkbox"/> Schedules/ Programmes	<input type="checkbox"/> Report	<input type="checkbox"/> Statutory Issues (HOC)	<input type="checkbox"/> Others
Attachment	<input type="checkbox"/> Samples	<input type="checkbox"/> Drawings	<input type="checkbox"/> Catalogue	<input type="checkbox"/> CDs
Purpose of Issue (Tick Applicable)	<input type="checkbox"/> FOR INFORMATION	<input type="checkbox"/> FOR FURTHER ACTION	<input type="checkbox"/> FOR RECORD	<input type="checkbox"/> FOR REVIEW

Detail: Please find T&C documents for Air balancing & water balancing of HVAC System from 3<sup>rd</sup> party independent agent for TAB including commissioning documents, list of instruments, calculations & template for Commissioning documents for Engineers approval.

Issued By: Signature: [Signature] Action Required By: [Signature]

Reference Documents: (Attach) [List of documents]

Received By: (The Engineer) Date: 27 NOV 2012

Comments (if Any): **No objection for approval/status (AS)**

- Provide a Drawings for all Measurement instrument To show the location for this items in all net
- Provide a table for determine the Recommended Reading for all Measurement instruments
- all check Lists shall be in excel sheets

MIS TMT 190 - CS-24 - Document Transmittal Form Ver.-04 01 July 2010 Page 1/1

Project: - ADFS - Programe Phase-3,Package – 4  
 Client:-M/s. Abu Dhabi Education Council  
 Consultant: - M/s. KEO International  
 Main Contractor: - M/s. Hill International  
 Hvac Contractor: - M/s. Al Fara's Engineering

**Sub-Contractor / Supplier Submittal Form**

Record Reference: Date: 13/Sep/2012  
 Project Name: Abu Dhabi Future School Program - Phase 3 - Package 1  
 Client: ADEC  
 Engineer: Dewan Arch. & Engineers  
 IR No: SCS-AL-MEP-010

Discipline:  Civil  Architecture  Mechanical  Electrical  Others

Description of work to be performed:  
**Agency For Commissioning Management, Testing, Adjusting & Balancing Services. (Under ETA)**

Sub-Contractor / Supplier Detail:  
 Name: Prime Technologies LLC.(Not in vendor List)  
 Trade: Prime Technologies LLC.(Not in vendor List)  
 Experience: Since 1998.  
 Location: Abu Dhabi.  
 Address: P.O Box 33824.  
 Contact Name: Mr. Imran Mobile phone #: 0554026272  
 Is the company certified against any quality standards: Yes  
 Adherence to quality system: Yes  
 Adherence to HSE: Yes  
 Is the company OHSAS 18001 (Health and Safety Certified): No

Attachment:  
 Chamber of Commerce:   
 UAE License:   
 Municipal License:   
 Other Licenses:   
 Pre-qualification:   
 Specifications:

Contractor Signature and Stamp: [Signature] Date: 13/Sep/2012

Received By: [Signature] Date: [Signature]

The Engineer: [Signature] A- Approved with Comments B- Approved with Comments / Resubmit C- Revise and Resubmit D- Rejected

Comments:  
 Refer to attached comment sheet and IM letter (ref # HILL/DAC/ETA/2012/001) dated 3.12.12 - copy attached

Reviewed By & Signature: (The Engineer) Approved By & Signature: (The Engineer)

Received By (The Contractor) [Signature] Date: [Signature]

Distribution:  
 Musanada  PMC  Engineer  Contractor

Project: - ADFS-Programme Phase-3,Package – 1  
 Client: - M/s. Abu Dhabi Education Council  
 Consultant: - M/s. Dewan Arch. & Engineers  
 Main Contractor: - M/s. Amana Contracting Steel Building Co  
 Hvac Contractor: - M/s. ETA MNE – Abu Dhabi

Sheikh Khalifa Specialist Hospital (RAK)

Contract No.: 2008-1-08-05-B279-SKSHJV Work Package: MEP

**TITLE: Compliance Statement for Testing, Adjusting & Balancing, Air & Water**

TO: CORE / IPRO DATE: 22/08/2011  
 FROM: CSCEC / MCM JV REVISION NO: 01  
 ATTN: CREF: SKSH-SC-M-MS-118A

Shop Drawings & Schedule  Programme  Pro-Qualification  
 Samples  Certification, Verification & Test reports  
 Materials & Product Data  Verification of Performance  Mock Ups & QC Panels  
 As Built Drawings  Inspection & Test  Method Statement

CIVIL  STRUCTURAL  ARCHITECTURAL  ELECTRICAL  MECHANICAL  OTHER

This approved *subjected to w/ attached comments*

Name: *[Signature]* Signature: *[Signature]* Date: 28/08/2011

RECEIVED 28 AUG 2011 RECEIVED 22 AUG 2011

Name: CSCEC / MCM JV PROJECT RAK CORE / IPRO  
 Name: *[Signature]* Date: 28 AUG 2011

APPROVED AS MTD  WORK MAY PROCEED - REVISE / RESUBMIT WITHIN \_\_\_\_\_ DAYS  WORK MAY NOT PROCEED REVISE / RESUBMIT

REVIEW NOT REQD

SUBMITTAL SHALL BE AS 01000-43 (Rev.01). REFER TO THE ATTACHED COMMENTS & COMPLY

CONSULTANT'S SIGNATURE: *[Signature]* DATE: 28 AUG 2011  
 CONTRACTOR'S SIGNATURE: *[Signature]* DATE: 28 AUG 2011

SKSH-RAK RECEIVED 29 AUG 2011 ETA M & E DIVISION

Project:-Sheikh Khalifa Specialist Hospital – RAK

Client: -M/s. Committee Rural Development

Consultant: - M/s. Bayaty Architects

Main Contractor: - M/s. Mcm – Csec Jv

Hvac Contractor: - M/s. ETA MNE

ARJAAN ROTANA - Capital Centre, Pjot. No C14, Sector W59/01

EMPLOYER: Bin Hamoodah Properties DATE: 14.07.2012  
 CONSULTANT: GA Architects & Engineers (GA) Ref.No: PRE/91/12  
 CONTRACTOR: United Engineering Construction - UNEC SHEET: 1 OF 3

**SUB-CONTRACTOR PREQUALIFICATION SUBMITTAL - PRE/91**

We hereby submit the following sub-contractor's prequalification for your approval / comments:

NAME OF PROPOSED SUB-CONTRACTOR: PRIME TECHNOLOGIES LLC.

SCOPE OF WORK: Trading, Testing & Balancing, Commissioning an Services, Sound Analysis and Design Consultancy.

A - LIST OF ATTACHED DOCUMENTS:

1. Statement of executed projects	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
2. List of Human Resources	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
3. Management organization chart	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
4. List of Equipment	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
5. Brochures / Photos	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
6. Registration Certificates	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No

B - FACTORY / WORKSHOP ADDRESS:  
 M/S PRIME TECHNOLOGIES LLC, P.O BOX, - 26736 DUBAI UAE  
 Tel: 04- 3256555, Fax: 04- 3234374

C - ANY OTHER INFORMATION:

CONTRACTOR: United Engineering Construction - UNEC  
 SIGNATURE: *[Signature]* P.O. Box: 112542, Abu Dhabi, United Arab Emirates  
 NAME: Saleem Bahr DATE: 14/07/2012

Accepted *subjected to full compliance with the specifications and approved technical submission*

Approved  Approved as Noted  Revise & Resubmit

PROJECT MANAGER'S COMMENTS: *Mohd. Tareef 31/7/2012*

RECEIVED BY CONTRACTOR: *[Signature]* DATE: 31 JUL 2012

Project: - Arjaan Rotana Capital Centre

Client: - M/s. Bin Hamoodah Properties

Consultant: - M/s Ga Architects & Engineers

Main Contractor: - M/s. United Engineering Construction

Hvac Contractor: - M/s. IEMSC. LLC

**AL BADIE HOTEL CAPITAL CENTER**

**cyril SWEETT**

EMPLOYER : Al Badie Group for Trading & Investment  
 PROJECT MANAGER : Cyril Sweett  
 CONSULTANT : GA Architects & Engineers (GA)  
 MEP CONTRACTOR : International Electro - Mechanical Services Co. LLC  
 CONTRACTOR : Group 3 Engineers Contractors L.L.C.

DATE : 14/05/2013  
 No. : GJ131MECHAC/PQ001 - Rev.01  
 SHEET : \_\_\_\_\_ OF \_\_\_\_\_

**Group 3**  
 Engineers Contractors L.L.C.  
 Q2 - 151

**SUB-CONTRACTOR PREQUALIFICATION SUBMITTAL (TAB OF HVAC SYSTEM)**

We hereby submit the following sub-contractor's prequalification for your approval / comments:

NAME OF PROPOSED SUB-CONTRACTOR: \_\_\_\_\_ M/s. PRIME TECHNOLOGIES

**A - LIST OF ATTACHED DOCUMENTS:**

1. Statement of executed projects	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No
2. List of Human Resources	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No
3. Management organization chart	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No
4. List of Equipment	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No
5. Brochures / Photos	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No
6. Registration Certificates	<input checked="" type="checkbox"/>	Yes	<input type="checkbox"/>	No

**B - FACTORY / WORKSHOP ADDRESS:**  
 PO BOX - 28726, DUBAI, UAE  
 TEL: 04 - 3096955, FAX: 04 - 3096974

**C - ANY OTHER INFORMATION**  
 PROPOSED AGENCY TO CARRY OUT TESTING, ADJUSTING AND BALANCING OF HVAC SYSTEMS

Received By: Group 3  
 Received by: Cyril Sweett  
 Received by: CONSULTANT (GA)

Signature: \_\_\_\_\_  
 Stamp: \_\_\_\_\_  
 Date: \_\_\_\_\_

Signature: \_\_\_\_\_  
 Stamp: \_\_\_\_\_  
 Date: 16 MAY 2013

Signature: \_\_\_\_\_  
 Stamp: \_\_\_\_\_  
 Date: \_\_\_\_\_

*M/s prime Technologies prequalification as a third party TAB of HVAC system is accepted subjected to their performance at site.*

Approved  Approved as Noted  Revise & Resubmit  Rejected

Mon. Jaree 19/5/2013

Signature: \_\_\_\_\_  
 Stamp: \_\_\_\_\_  
 Date: \_\_\_\_\_

Signature: \_\_\_\_\_  
 Stamp: \_\_\_\_\_  
 Date: 22 MAY 2013

Project: - Al Badie Hotel Capital Centre

Client: - M/s. Al Badia Group For Trading & Investment  
 Consultant: - M/s Ga Architects & Engineers

Main Contractor: - M/s. Group 3 Engineers Contractors LLC  
 Hvac Contractor: - M/s. IEMSC.LLC

**Bloom.** BroadwayMalyan™ **الروستاماني بيجول ليم**  
 AL ROSTAMANI PEGEL L.L.C.

**REQUEST FOR APPROVAL OF MATERIALS**

Proj. No. / Proj. Name: Bloom Academy	ARP Submittal Ref.:
Client: Bloom Emirates Properties LLC	ARP/P073/MS/ 0024
Consultant: M/s Ian Banham Associates	Revision: 0
Main Contractor: Al Rostamani Pegel LLC	Subcontractor Submittal Ref.:
Subcontractor: M/S ETA (UAAD)	39910-ETA-SUB-VAC-028
Date: 1/4/2013	Revision:00

We hereby submit the following material(s) for your approval.

Architectural  Structural  Electrical  Mechanical  Other \_\_\_\_\_

Sample  Catalogue  Spec  Comparison sheet

Submitted by ARP  
 Signature & date: \_\_\_\_\_  
 Received by Consultant: \_\_\_\_\_  
 Signature: \_\_\_\_\_  
 Date: 01 APR 2013

Subcontractor  
 Signature & date: \_\_\_\_\_  
 Date: \_\_\_\_\_

Date submitted: \_\_\_\_\_ Approval required within \_\_\_\_\_ days from date of this submittal (in accordance with Contract specifications)

Description	Location of use	Specs / BOQ / Drwg ref.	Specified Make & country of origin	Sample / catalogue	Any other information
Pre qualification for testing and commissioning (ventilation and Air conditioning system)	INTERNAL & EXTERNAL	ATTACHED	Prime Technology	ATTACHED	

A - Approved  B - Approved with comments  C - Not approved  
 REVIS: 017

**CONSULTANTS COMMENTS**

REFER TO THE COMMENTS ON THE ATTACHED SHEET.

Signature: \_\_\_\_\_  
 Date: 15/04/13

Signature: \_\_\_\_\_  
 Date: 16-4-13

For the Consultant: \_\_\_\_\_  
 Name: \_\_\_\_\_ Signature: \_\_\_\_\_ Date: 16.4.2013

Received by ARP  
 Signature: \_\_\_\_\_ Date: 10 APR 2013





PM/SPM  Ops. Man  QM  Plan&Tec  Comm.

Project: - Bloom Academy

Client: - M/s. Bloom Emirates Properties LLC  
 Consultant: - M/s. Ian Banham Associates

Main Contractor: - M/s. Al Rostamani Pegel LLC  
 Hvac Contractor: - M/s. ETA



		<b>Document Submittal</b>	
<b>Project</b> : Al Ain Stadium & Mixed Use Development <b>Employer</b> : Aafaq Holdings LLC <b>Engineer</b> : EC Harris <b>Contractor</b> : BAM International		<b>PRE No.</b> : AAS-ETA-MEP-PWD- PRE-00001 <b>Rev.</b> : 00 <b>Date</b> : 17/03/2013 <b>Req. by</b> : 31/03/2013	
<b>Originator of Submittal</b>		EMIRATES TECHNICAL ASSOCIATES	
<b>Authorized Signature</b>			
<b>C.C.:</b>			
<b>Documents Detail</b>		<b>List of Enclosure</b>	
<b>Item Description</b>	<b>Pre-qualification Documents for Independent Commissioning Management and Testing, Adjusting &amp; Balancing Services</b>	(Tick the related box)	
<b>Manufacturer/Local Supplier</b>	<b>Commtech &amp; Prime Technologies</b>	<input checked="" type="checkbox"/> Company General Information <input checked="" type="checkbox"/> Company Trade License <input checked="" type="checkbox"/> ISO Certification <input checked="" type="checkbox"/> BSRIA Certificates <input checked="" type="checkbox"/> Organization Structure <input checked="" type="checkbox"/> List of Previous Projects done <input checked="" type="checkbox"/> Others (specify)	
<b>Remarks</b>	NIL		
<b>Main Contractor Signature</b>		<b>Date:</b> 17/03/2013	
			
<b>Employer's Representative Comments:</b>			
Approved with comments STATUS "B"  SEE ATTACHMENT FOR COMMENTS.		<input type="checkbox"/> REV = Reviewed <input type="checkbox"/> NRR = No Review Required <input type="checkbox"/> INF = Information Only	
<b>Employer's Representative Signature</b>		<b>Date:</b>	

Project: - Al Ain Stadium

Client: - M/s. Aafaq Holdings LLC

Consultant: - M/s. EC Harris

Main Contractor: - M/s. Bam International

Hvac Contractor: - M/s. ETA MNEE – Abu Dhabi

Transmittal Letter: F2NP-TS-FER-AMN-5012

Ruwais Fertilizer Industries [FERTIL]  
 Sheikh Khalifa Energy Complex  
 P.O. Box 2288, Abu Dhabi  
 United Arab Emirates  
 Ph. +971 2 6026965, Fax. +971 2 6021112  
 Email: projects@fertil.com, Web: www.fertil.com

Date: 24<sup>th</sup>, June 2013

To: **AMANA Steel Buildings Contracting LLC**  
 P.O. Box 27444  
 Dubai UAE  
 Tel: +971 48854448, Fax: +971 48859030

Attention : **Mr. Lakshmi Pathy (Project Manager)**  
 Ref. : Non Process Buildings and Revamping Works in Existing Plant  
 Contract No. : EXP-007-10-NPBC

**We are sending you**

<input checked="" type="checkbox"/> Attached	<input type="checkbox"/> By Courier	<input type="checkbox"/> By Email	<input type="checkbox"/> By Hand
<input type="checkbox"/> Drawings	<input checked="" type="checkbox"/> Prints	<input type="checkbox"/> Plans	<input type="checkbox"/> Company documents
<input type="checkbox"/> Copy of Letter	<input type="checkbox"/> Change Order	<input type="checkbox"/> Samples	<input type="checkbox"/> Shop Drawings
<input checked="" type="checkbox"/> Soft Copy	<input type="checkbox"/> Reproducible	<input type="checkbox"/> Specification	

Dear Mr. Lakshmi Pathy,

Please find attached the documents listed below, reviewed by the COMPANY and issued with status shown.

SN	Document No.	Description	Rev	Status
1	F2NP-00-EG-MST-0011-046	Method Statement for Testing & Commissioning Procedure for HVAC Systems by Third Party - M/s. Prime Technologies	002	Code D

**These are transmitted as checked below**

<input type="checkbox"/> For Approval	<input checked="" type="checkbox"/> Approved	<input type="checkbox"/> Resubmit copies for approval
<input type="checkbox"/> For Information & Action	<input type="checkbox"/> Returned with Comments	<input type="checkbox"/> Submit copies for distribution
<input type="checkbox"/> As Requested	<input type="checkbox"/> Returned for Corrections	<input type="checkbox"/> Return corrected prints
<input type="checkbox"/> For Review and Comment	<input type="checkbox"/> Revise and Resubmit	
<input type="checkbox"/> FOR BIDS DUE:	<input type="checkbox"/> Not Approved	<input checked="" type="checkbox"/> Acknowledge the Receipt.

**Notes:**  
 All works related to attachment should be strictly completed prior to start of pre-commissioning/commissioning activities.

Copy to:

1.	3.
2.	4.

Best regards,  
  
 Shankar Narayan  
 Buildings Team Leader




Page 1 of 1

Project: - Non Process Buildings & Revamping

Client: - M/s. Fertil

Consultant: - M/s. Fertil

Main Contractor: - M/s. Amana Steel Buildings Contracting LLC

Hvac Contractor: - M/s. Menasco Mech. Contracting LLC

**EC Harris International**

Submitted No: 4011 Rev: 00 ETS No: SCA- Date: 29/10/2008

Project Name: **The Landmark Tower Project**

To: **Pelli Clark Pelli Arch. / Buro Happold** Project No.: **HC-1000**

Enclosed please find the drawings/ documents/ samples listed below

S. No.	DRWS., SPEC. REF.	DESCRIPTION	TYPE	CODE	
				Submitted For	Action
1	Spec. 15990	Pre-qualification Document of M/s Prime Technologies LLC for HVAC Pre-commissioning, Testing, Adjusting & Balancing Services Sub-contractor	SC	1	A
		Prepared By: M/s. ETA			

Trade Check List:  
 Architectural  Structural  Mechanical  Electrical  Plumbing  Others

FOR CONTRACTOR:  
 Project Manager (T & C): **Samer Haddad** Signature: *[Signature]* DATE: 29/10/2008  
 Supervising Architect/Supervising Eng. COMMENTS:

As an organization "Prime Technology" are acceptable. Submit via Method Statements project specific information such as commissioning forms, organization charts, involvement of all parties, etc, all as required by the specification.

FOR CONSULTANT:  
 Supervising Architect/Supervising Engineer Signature: *[Signature]* DATE: 16 Nov 08

PROJECT MANAGER'S COMMENTS:

This approval does not release the Contractor from his obligations and responsibilities under the Contract.

FOR PM:  
 Project Manager Signature: *[Signature]* DATE:

TYPE: SD: Shop Drawing CA: Calculation MT: Material MS: Method Statement SC: Sub-Contractor OT: Other

Project: - The Landmark Tower  
 Client: - M/s. Dopa  
 Consultant: - M/s. Buro Happold  
 Main Contractor: - M/s. Al Habtoor  
 Hvac Contractor: - M/s. ETA MNE – Abu Dhabi

**Burj Al Marina Com 08**

KEO International  
Date: 26/01/2014

Transmittal No. : AFE-P98-GEN-PQ-GRT-0317\_00  
 Dated : 05<sup>th</sup> January, 2014  
 Date Received : 06<sup>th</sup> January 2014  
 Document No. : P98-AFE-GEN-PQ-0017\_00  
 Subject : Pre-Qualification for Commissioning Management and testing, Adjusting & Balancing Services for HVAC Works

**Status: B, No Objection Subject to incorporation of comments**

KEO's Comments:

- "No objection" to the proposed sub contractor (M/s Prime Technologies) to carry out the Commissioning management, testing, adjusting & balancing services for HVAC works subject to compliance with Project specifications and design documents, and authorities approval.
- Provide a detailed project specific organization chart indicating the requirement of Engineering, site executing, testing commissioning staff.
- Provided detailed project specific scope of work complying with the specifications requirements and QCS.
- AFE shall be responsible for providing detailed method statement for the scope of works along with the ITP requirement, risk assessment etc. and relevant standards.
- AFE shall be responsible to undertake all necessary approvals/coordination with authorities (Lusail/Marafaq).
- Contractor shall confirm that the representative of M/S Prime Technologies shall participate in the site discussion as per the Project requirement and as deemed necessary by the Consultant.
- M/S Prime Technologies shall comply with all the HSE and quality requirements on the Project.
- It is overall responsibility of AFE to ensure that M/S Prime Technologies, as their sub-contractor shall comply with the Project requirements as per specifications and other design documents.

Comments Prepared by:	Anwar Rizvi <i>[Signature]</i>	Date:	26 January 2014
Reviewed by:	Jincy Phillip <i>[Signature]</i>	Date:	26 January 2014

Action:  
 A. No Objection  
 B. No Objection Subject to incorporation of comments  
 C. Rejected, to be resubmitted

Comments or comments made relative to submittals during this review does not relieve the contractor from compliance with the requirements of his Contract, drawings and specifications. This review is only in respect of general conformance with the design intent of the project and general compliance with the information given in the Contract documents. The contractor remains responsible, among other things, for the design of the project or such parts of the project he has design responsibility for, (if design forms part of the Contract), for confirming and correlating all quantities and dimensions, selecting fabrication processes and techniques of construction, coordinating his work with that of other trades, and performing his work in a safe and satisfactory manner, all in accordance with the Contract.

Project: - Burj Al Marina – Qatar  
 Client: - M/s. Qatari Diar Real Estate Investment Company  
 Consultant: - M/s. KEO International  
 Main Contractor: - M/s. Redco International  
 Hvac Contractor: - M/s. Hamad And Mohamad Al Futtaim

**AL SAFOOH TRANSIT SYSTEM PROJECT**

**PREQUALIFICATION SUBMITTAL**

New Submittal  Re-Submittal

Prequalification Submittal No: ELS10-SGE-B600-BSC-GEN-00075 | Revision: A | Date: 04-Oct-2012

Company Name: Prime Technologies LLC

Responsibility: Testing and Commissioning Management

Field of Work / Specialisation: ETA Scope of Works

Location of Work: Stations

Reference (BOQ, Drawing, Material, etc):

**ENCLOSURES:**

<input checked="" type="checkbox"/> Description of the Company Function and its Activities	<input checked="" type="checkbox"/> Experience / Know-how	<input checked="" type="checkbox"/> C.V. of Key Positions
<input checked="" type="checkbox"/> The Company Specialisation	<input checked="" type="checkbox"/> Experience	<input checked="" type="checkbox"/> References and Acknowledgements
<input checked="" type="checkbox"/> Trade License / Registration	<input checked="" type="checkbox"/> List of Executed Projects	<input type="checkbox"/> Method Statement
<input checked="" type="checkbox"/> Certificate of Quality	<input checked="" type="checkbox"/> List of Manpower	<input checked="" type="checkbox"/> QM/QC Manual / Procedure
<input type="checkbox"/> Concerned Authority Approval	<input checked="" type="checkbox"/> List of Equipment	<input type="checkbox"/> HSE Plan
<input type="checkbox"/> Accreditation	<input type="checkbox"/> Organisation Structure	<input type="checkbox"/>

Scope of Work to be Performed by the Proposed Subcontractor:  
Testing, Commissioning, adjusting and balancing of electromechanical equipments for ETA scope of work at stations.

For The Contractor

Checked by: TECHNICAL MANAGER: Name: M. HOLDEN Signature: [Signature]

Checked by: PROJECT MANAGER: Name: J.P. DALEM Signature: [Signature]

Endorsed by: PROJECT DIRECTOR: Name: B. MENDIAUX Signature: [Signature]

**THE ENGINEER (SYSTRA) CONSENT AND COMMENTS:**

Consent is Given  Consent on Hold (Additional Information is Required)

Consent is Given with Comments (See the Explanation Below)  Rejected

**COMMENTS / EXPLANATION:**

The Pre-Qualification Reviewer

Position: Sr. Planning Engineer Name: Mohamed HSGAIB Signature: [Signature] Date: 22/10/2012

Engineer's Representative

Position: Project Director Name: Hani Ziad Signature: [Signature] Date: 23/10/12

Concerned Authority Approval

AUTHORITY: REVIEWER NAME: SIGNATURE: DATE:

ification Submittal No: Page of

Project: - Al Safooh Transit System Project

Client: - M/s. Road & Transport Authority

Consultant: - M/s. Systra

Main Contractor: - M/s. Besix

Hvac Contractor: - M/s. ETA set Jv

**SYSTEM CONSTRUCT LLC**

**Ruwais Housing Complex Expansion - Phase III**

**Marked Plans - Package 11 - Project No. 6033**

**Arrestment No. H6033C1**

**DRAWING DOCUMENT TRANSMITTAL FORM**

Transmittal No.: DTF-3406 | Date: 14.11.2013 | Resp. By: [Signature]

From: SYSTEM CONSTRUCT LLC | To: M/s ADNOC | Attn: Project Manager

Document class  First submission  Second submission  Further submission

Previous Submittal Ref.: DTF-3307 | Date: 07.10.2013 | Category: C | S/C Ref: | Date:

Sr.No.	Document No.	Description	Rev	Copies	Approval Category
1	SYS-6033-ABI-MSC-0008	Pre-Qualification & ADNOC Registration Document of M/S Prime Technologies For Third Party Testing & Commissioning For HVAC & Plumbing Works	01	2	B

Architectural  Structural  Mechanical  Electrical  Plumbing  Others

THIS SUBMITTAL INTENDED FOR

APPROVAL / COMMENTS

AS PER YOUR REQUEST

YOUR INFORMATION / RECORDS

For: System Construct LLC

Project Manager: Oussama El Bardidi

For ADNOC

Accepted  Accepted Subject to comments

Comments:

- ADNOC registration is mandatory. Proposed 'M/s. Prime Technology' as Testing and Commissioning 3<sup>rd</sup> Party is acceptable subject to fulfilling the requirement of confirming the same.
- The scope of work for Testing and Commissioning shall be as per the Contract Specification section 15950.
- Detailed Method Statement complying with Specification shall be submitted with separated DTF's
- As specified, Testing and Commissioning Agency lead Engineers should have minimum of 7 years dedicated experience as a Test and Balance Engineer. Propose the lead Engineers accordingly.

Mohamed Al Shuraidi | Project Manager | SIGNATURE: [Signature] | DATE: 08 DEC 2013





Project:-Ruwais Housing Complex Ex- Phase 3

Client: - M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor: - M/s. System Construct LLC

Hvac Contractor: - M/s. Albonian International








 The Engineer DESIGN & ARCHITECTURE BUREAU (DAR) CONSULTING ARCHITECTS & ENGINEERS		 The Contractor BUHALEEBA CONTRACTING LLC	
Project: <b>2B+G+24 Residential &amp; Commercial Building on Plot 231-215 at Al Nahda 1<sup>st</sup>, Dubai for H.E.Mr. Mattar Al Tayer.</b>			
From: Bu Haleeba Contracting LLC.		To: DAR Consult	
<b>Technical Submittal</b>		Ref. No. TS-0017 Rev.01	Date: 08/11/14
		Required By: IAN BANHAM	Division: MEP
Description of Submittal : <b>PRE-QUALIFICATION FOR HVAC TESTING &amp; COMMISSIONING (PRIME TECHNOLOGIES)</b>			
Originator of Submittal : <input type="checkbox"/> Test Results <input type="checkbox"/> Method Statement <input type="checkbox"/> Certificate <input checked="" type="checkbox"/> Pre-Qualification of Subcontractor <input type="checkbox"/> Others			
Contractor's PM : Signature & Date: 		Received By DAR Consult : Signature & Date:	
<b>Review Status</b> <input type="checkbox"/> A. Approved <input checked="" type="checkbox"/> B. Approved As Noted <input type="checkbox"/> C. Approved As Noted, Resubmit <input type="checkbox"/> D. Not Approved, Resubmit			
<b>Engineer's Representative Comments:</b> No objection for the proposed Testing & Commissioning agency. 1- Subject to comply with the following: 2- Submit site organization chart for the site staff including CVs for the all engineers & technicians. The employees should have satisfactory previous experience. 3- Submit a list of all equipments/instruments to be used for this job along with updated calibration certificates. 4- Noise test shall be conducted. 5- The stop drawing of HVAC system shall be checked by the contractor and to advise for any requirements, such as test points, adjustment adjustments, access etc. 6- Progress of work to be submitted in combination with main contractor to building authority. 7- Daily report to be submitted for the progress & observation.			
Engineer's Representative : Signature & Date: 		Received by Contractor : Signature & Date:	
Corrections or comments made relative to submittals during this review do not relieve the contractor from compliance with the contract requirements and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents.			

Project:-B+G+26 Res. & Comm Bldg Al Nahda

Client: - M/s. Mattar Al Tayer

Consultant: - M/s. Dar Consult

Main Contractor:-M/s. Bu Haleeba Contracting LLC  
 Hvac Contractor: - M/s. Bin Shafar Electro Mechanical Engineering LLC

 HVAC & Electrical Modification Works On Plot No- 368-414, At Al Quoz - U.A.E		 	
<b>Material Approval Request</b>			
MAR No. IEM / 103 / MA / AC - 28	Date: 21.5.14	Classification: Rev 0	
Project No : GCE - 147	Employer : Modern Bakery LLC	Consultant : Green Concept Engineering	
MEP Contractor : International Electromechanical Services Co.(L.L.C)	CIVIL Contractor : Maawa Building Contracting LLC		
Material Description	TAB WORKS	List of Enclosures (Tick the Related Box)	
Spec./BQ/Dwg. Reference	VOL II / SECTION 1 / ITEM 30	<input checked="" type="checkbox"/> Vendor's Technical Literat.	
Manufacturer Specified	CMLI2/PRIME/SATTUN	<input type="checkbox"/> MS Certificates	
Material Proposed	PRIME	<input type="checkbox"/> Compliance Statement	
Manufacturer / Local Supplier	PRIME TECHNOLOGIES	<input type="checkbox"/> Data Specification	
Reasons for Alternative		<input type="checkbox"/> Samples	
Remarks		<input checked="" type="checkbox"/> List of Previous Projects	
Issued by M/s. International Electromechanical Services	Received by M/s. Green Concept Engineering		
Project Manager:  21/5/14	Date: 	Date: 21/5/14	
Response required date : <b>FOR THE USE OF GREEN CONCEPT ENGINEERING</b>			
<input type="checkbox"/> 1- Approved <input type="checkbox"/> 3- Revise and Resubmit <input type="checkbox"/> 5- Not Reviewed <input checked="" type="checkbox"/> 2- Approved With Comments <input type="checkbox"/> 4- Rejected <input type="checkbox"/> 6- Other			
NOTE :- For Action 3 and 4 a copy of this transmittal to be attached to the Re-Submittal			
Comments : 1- No objection to the proposed company. 2- Method Statement to be submitted for the TAB works 3- organization chart to be submitted for the project			
Reviewed By: 	Date: 22/5/14		
Engineer's Representative:			
Received By: M/s. International Electromechanical Services Co.(L.L.C)			
Project Manager:			

Project: - Modern Bakery

Client: - M/s. Modern Bakery LLC

Consultant: - M/s. Green Concept Engineering

Main Contractor: - M/s. Maawa Building Contracting LLC

Hvac Contractor: - M/s. IEMSC.LLC

The approval by the Engineer does not relieve Contractor / Sub-contractor from his obligations/responsibilities under the contract and shall not constitute a departure from the contract

4- Prime technologies to check the hvac drawings and advise any requirement for the TAB works

**AL RAWDHA PALACE, AL AIN**  
**UTILITY BLOCK 2 & MEP INFRASTRUCTURE WORKS**

**NOTIFICATION TO START (NTS)**

ITR No: E T A - N T S - U 2 - HVAC - 11 | Rev: 0 | 0

ISSUE DATE: 07 July 2012 | TIME: 03:00 P.M. | Civil ITR Ref: HVAC

REQUESTED FOR INSPECTION DATE: 08 Jan 2012 | TIME: 08:00 A.M. | Block: UB-2 (SV, AW & MV)

You are kindly requested to inspect the following:  
 Item: NOTIFICATION TO START COMMISSIONING AND BALANCING WORKS OF CHILLED WATER PRIMARY SIDE AND SECONDARY SIDE OF HEAT EXCHANGER AT SWIMMING POOL VILLA BASEMENT, A/C WALKWAY BASEMENT-2 AND MAIN VILLA GROUND FLOOR MECHANICAL ROOM (PRIMARY SIDE).

Location: SV BASEMENT, A/C WALKWAY BASEMENT-2, MV GROUND FLOOR MECH ROOM

Drawings Reference: ETA-SD-U2-SV-AC-01 Rev-0, ETA-SD-U2-MV-AC-PL-02 Rev-0, ETA-SD-U2-AW-AC-02 Rev-0

Section: Eng. ETA MEP Coordinator Verification:  
 Name: YASSER ANAN | Name: M.A. SATTAR SIDDIQUI

Signature: [Signature] | Date: 07 July 2012 | Signature: [Signature] | Date: 07 July 2012

**CONTRACTOR'S COMMENTS:**  
 → Commissioning and Balancing works can proceed in the walkway and Swimming pool mechanical rooms.  
 → Commissioning in main villa can proceed after the completion of floor epoxy works. Epoxy works will be carried out along with coordination with E.T.A.  
 → Care to be taken during commissioning as regards to any spill, epoxy, paint.

APPROVAL BY M/s. DEWAN CONSULTANT: Subject to the following:  
 1. T.C. team organization chart to be submitted & approved.  
 2. T.C. method statement, forms, procedure and programme to be submitted & approved.  
 3. T.C. test & check devices with valid calibrated certificate to be submitted & approved prior to start of work.

Approval: [Signatures] | Final Closure of ITR By: Dewan  
 Eng. Signature: [Signature] | Date: 12/07/12

Project: - Al Rawdha Palace - Al Ain

Client: - M/s. Dept. Of The Presidents Affairs

Consultant: - M/s. Dewan Archetechs & Engineer

Main Contractor: - M/s. Arabian Cont. Co.

Hvac Contractor: - M/s. ETA M&E

**WASL** | **TRANSMITTAL SHEET**

Project: R-1012 AL MINA Hotel Development on Plot No. 321-236 | Client: Wasl LLC

To: Engineer | CC: Engineer | PM: Other

Issue Number: A AC/MS/AMHD/TS/1040 | Date: 28 Aug 14 | Sheet no: 1 of 1

Description:  Drawings  Specifications  Samples  Report  Materials

Category:  CIVIL  MEP  Architectural  Testing & Commissioning

Sr. No.	Document Ref. No.	Description	Type	Copies	PM Action
1	IEM100-MA-AC-33	Testing and Commissioning for Air Balancing and Water Balancing	T & C	1+4+Soft Copy	

KEY: SD = Shop Drawings, SM = Sample, GT = Guarantee, MD = Manufacturer's Data, CF = Certificates, TR = Test Results  
 AB = As Built, OT = Other

Supplier/Manufacturer: M/s Prime Technologies  
 Sub-Contractor: M/s. IEMS

We certify that this submittal herewith have been reviewed in detail and are in strict conformance with the contract drawings and specifications except as otherwise stated.

Contractor: Al Ahmadiyah Contracting & Trading | Contractor MEP Co-ordinator: Yehya Murad

Contractor PM: Mr. Muthu Krishnan | Signature/Date: [Signature] | 28 AUG 2014

Received by: [Signature] | Consultant's Comments:  Approved  Approved as Noted  Resubmit  Rejected

1. PROVIDE COMPLIANCE STATEMENT FOR THE SUBMISSION  
 T & C  
 2. PROVIDE SPECIFIC ORGANIZATION CHART FOR THE ENGINEER AMB/CM/AB ASSIGNED FOR THE PROJECT. SAME SHOULD BE SUBJECT TO CONTRACTOR'S APPROVAL BASED ON INTERVIEW EVALUATION.  
 3. PROVIDE METHOD STATEMENT FOR T & C OF ALL TYPES OF SYSTEMS  
 4. PROVIDE SPECIMEN TEST SHEETS FOR ALL TYPES OF TESTS  
 5. PROVIDE LIST OF TEST INSTRUMENTS AND CALIBRATION CERTIFICATE WITH SERIAL NO AND VALIDITY DATES  
 6. SUBJECT TO FULL COMPLIANCE OF SUBMISSION (DRAWING / SPS) DETAIL RELEVANT  
 7. TARGET CODES / STD TO BE INCLUDED FOR AIR/WATER BALANCING  
 8. ROOM WISE data template - Temp, humidity etc included for the room  
 9. AMENDMENTS TO BE DONE AS REQUIRED FOR THE DRAWINGS

Consultant: [Signature] | Signature/Date: [Signature] | 28 AUG 2014

Received by: [Signature] | Signature/Date: [Signature] | 28 AUG 2014

Corrections or comments made to the submittal shall be submitted to the Contractor from compliance with the requirements of the drawings and specifications. This check is for general compliance only. The Contractor is responsible for confirming the accuracy of the submittal and ensuring that the work is done in accordance with the contract drawings and specifications. The Contractor shall be responsible for the safety and satisfactory manner of the work.

03 SEP 2014  
 Name: [Signature] | Signature: [Signature]

Project: - Al Mina Hotel Development



Client: - M/s. Wasl

Consultant: - M/s. Dimensions

Main Contractor: - M/s. Al Ahmadiyah Cont.

Hvac Contractor: - M/s. IEMSC.LLC

*original site  
cc: Mr. Ketty for procurement  
cc: Mr. NS for information  
17/11/14*

					
<b>TRANSMITTAL SHEET</b>					
Project: R-1013 - Al Muraqqabat Hotel Development on plot nos. 128-2370 Subplot		Client: Wasl LLC			
To: <input checked="" type="checkbox"/> Consultant <input type="checkbox"/> PM	CC: <input type="checkbox"/> Consultant <input type="checkbox"/> PM	<input type="checkbox"/> Other			
Issue Number: AAC/454/RG/MN/TS/1055 Rev.0	Date: 31-08-2014	Sheet no.: 1 of 1			
Description: <input type="checkbox"/> Drawings <input type="checkbox"/> Specifications <input type="checkbox"/> Samples	<input type="checkbox"/> MEP <input type="checkbox"/> Architectural <input type="checkbox"/> Others				
Category: <input type="checkbox"/> CIVIL	<input type="checkbox"/> MECHANICAL				
SR.No.	Sub Contractor Ref.	Description	Type	Copies	PM Action
1	IEM99-MS-AC-35	Technical Submittal for Testing and Commissioning of HVAC System - Prime Technologies - IEMS	MD	5	

**Enclosed hard and soft copy**  
 TYPE: SD = Shop Drawings, SM = Sample, GT = Guarantee, MD = Manufacturer's Data, CT = Certificates, TR = Test Results, AB = As-Built, OT = Other  
 Supplier/Manufacturer: M/s. Prime Technologies

We certify that the materials submitted herewith have been reviewed in detail against the design drawings and specifications except as otherwise stated.  
 Contractor: Al Ahmadiyah Contracting & Trading  
 Contractor PM: Muralidharan Nair  
 Signature: \_\_\_\_\_  
 Date: 31-08-2014

Received by: \_\_\_\_\_  
 Date: 01 SEP 2014

Consultant's Comments:  Approved  Approved as Noted  Resubmit  Rejected

1. PROVIDE COMPLIANCE STATEMENT FOR THE SPECIFICATION TESTING ADVANCING.
2. PROVIDE SUPPORT ORGANIZATION CHART FOR THE ENGINEER AND TECHNICIANS ASSIGNED FOR THE PROJECT. SAME SHALL BE SUBJECT TO CONSULTANT APPROVAL BASED ON INTERVIEW/ EVALUATION
3. PROVIDE NOTED STATEMENT FOR TCC OF ALL TYPES OF SYSTEMS
4. PROVIDE SAMPLE TEST SHEETS FOR ALL TYPE TESTS
5. PROVIDE LIST OF TEST INSTRUMENTS AND CERTIFICATE/COA with serial nos and valid dates.
6. SUBJECT TO FULL COMPLIANCE WITH SPECIFICATION/DRAWINGS/STC AND AUTHORITY REQUIREMENTS.
7. PROVIDE SERIAL NO/S FOR ALL INSTRUMENTS OR SHOW THE LOCATION

Consultant: Ali Ismail  
 Received by: Rajanathan 03/09/14

Copyrights or comments made relative to submittals during this review do not relieve the Contractor from compliance with the requirements of the drawings and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions, selecting fabrication processes and techniques of construction, coordinating his work with that of other trades and performing his work in a safe and satisfactory manner.

Edition - September 2009

*8. Latest test report to be concluded for all water balancing  
 9. Room wise data req, humidity etc to be done  
 10. Approval documents to be done as required for the permits as per norms*

Project Name: - Al Muraqqabat Hotel







Client: - M/s. Wasl

Consultant: - M/s. Dimensions

Main Contractor: - M/s. Al Ahmadiyah Cont.

Hvac Contractor: - M/s. IEMSC.LLC

*cc: Bob*

The Employer 	The Engineer 	The Contractor 	MEP Contractor 
<b>P30: Development Of Food Court &amp; Multi-Storey Car Park At Dubai Airport Free Zone Main Works Package</b>			
<b>MATERIAL APPROVAL SUBMITTAL</b>			
Date: 18.10.2014		Reference: FC/MEP/1442-A/S1/AC/MS/045/1	
Building: FOOD COURT			
Material Description: TESTING AND COMMISSIONING OF HVAC SYSTEM			
Model Number, Brand Or Code Of Proposed Material:		<input checked="" type="checkbox"/> Refer to the Attached Summary of Proposed Materials	
Location Of Use: FOOD COURT			
Specification Section: SECTION 1, PART A, PAGE 21-24			
Manufacturer Details		Supplier Details	
Name: N/A		Name: PRIME TECHNOLOGIES	
Country of origin		Country & City U.A.E., DUBAI	
Address		Address PO BOX: 5239	
1. Compliance Statement should be included in the submittal		2. Copy of the Contract Specification Section should be included in the submittal	
3. All sheets must be signed & sealed by the Contractor and the Specialist Subcontractors		4. Submittal reference number should be noted on the attachments	
MEP Contractor Representative Signature		The Contractor Representative Signature	
Date: 18.10.2014		Date: 18.10.14	
<b>THE ENGINEER COMMENTS:</b>			
2- TCC tools and devices with calibration valid certificate to be submit prior to start TCC work 2- TCC comply with standards, regulation and contract documents 2- subjected to performance at site			
<b>THE EMPLOYER COMMENTS:</b>			
As commented by Consultant			
 			
<b>ACTION:</b>			
<input type="checkbox"/> APPROVED	<input checked="" type="checkbox"/> APPROVED AS NOTED	<input type="checkbox"/> REVISE AND RESUBMIT	<input type="checkbox"/> SAMPLES AND/OR ADDITIONAL DATA REQUIRED
Reviewed By: _____	For The Engineer: _____	For The Employer: _____	

Project: - Food Court & Multi Storey Car Park –


Dubai Airport Free Zone

Client: - M/s. Dubai Airport Freezone

Consultant: - M/s. Lacasa Architects & Engineering Consultant

Main Contractor: - M/s. Ascon

Hvac Contractor: - M/s. IEMSC.LLC







MATERIAL SUBMITTAL - APPROVAL	
Project:	Project No: TIBC 215
KBZF Wedding Hall- Plot No. (18-4-0-900)	Ref. No. MS-TIBC-14-215-AC-42
Originator of Submittal: Engr. Samer / Engr. Atif	Rev. No. 0
Authorized Sign: 	Date: 30-Nov-14
Material Details	Read By:
Item Description: Third party for testing and commissioning - Air & Water Balancing 1. Company Profile 2. Method statement	List of Enclosures: <input type="checkbox"/> Vendor's Technical Literature <input type="checkbox"/> Compliance Statements <input type="checkbox"/> Previous Test Results <input type="checkbox"/> Copy of the Related Specs. <input type="checkbox"/> Samples <input type="checkbox"/> List of Previous Projects Done <input type="checkbox"/> Others (Specify):
Specs. Reference: Vol. III-b - Mechanical Works Part (6)	
BOQ Reference:	
Drug Reference:	
Material Specified:	
Material Proposed: PRIME TECHNOLOGIES	
Manufacturer / Supplier: PRIME TECHNOLOGIES	
Reason for Alternative:	
Remarks:	
Contractor Statement: We certify that the material submitted herewith has been reviewed in details and is in compliance with the contract drawings and specifications except as otherwise stated here above.	
Contractor's Project Manager: Eng. Mouftaq AL Khumi	Date: 30-Nov-14
No objection to employ M/s Prime Technologies as HVAC third party Subject to: 1) All balancing record reports shall be submitted together whatever air, water, temperature, humidity, etc. On the original format with contractor original stamp. 2) To submit the Pressure drop across pump in feet of water and total GPM when pump is handling under full flow conditions. 3) Recorded data shall represent actual measured or observed conditions. 4) To provide the temperature report everywhere along with humidity values.	
Engineer's Comments:	Date: 4/12/014
Approval or Comments do not relieve the Contractor of commitment to general & particular specification, project drawing, workmanship and follow regulation/requirement of all authorities.	

Project: - KBZF Wedding Hall

Client: - Khalifa Bin Zayed Al Nahyan

Consultant: - M/s. Golden Planners Consultants

Hvac Contractor: - M/s. Tiger International Building Cont

REQUEST FOR APPROVAL OF DOCUMENT (TECHNICAL)					
Proj. No. / Proj. Name: P077 / Private Villa - Emirates Hills	Client: IFFCO		ARP Submittal Ref.: ARP/P077/DS/135		
Consultant: jrhp	Main Contractor: Al Rostamani Pegel LLC		Revision: 0		
Subcontractor: Technical & Trading	Date: 15-02-15		Subcontractor Submittal Ref.: TTE-MAC/COMM-01		
We hereby submit the following technical document(s) for your approval, and verify that we have reviewed the submitted item in detail, and that it is in compliance with the specified requirements, except as stated otherwise.			Revision: 0		
<input type="checkbox"/> Architectural <input type="checkbox"/> Structural <input type="checkbox"/> Electrical <input checked="" type="checkbox"/> Mechanical <input type="checkbox"/> Other <input type="checkbox"/> Document <input type="checkbox"/> Guarantee <input type="checkbox"/> Certificate <input type="checkbox"/> Test <input type="checkbox"/> Other <input type="checkbox"/> Sample <input type="checkbox"/> Catalogue <input type="checkbox"/> Sketch <input type="checkbox"/> Other					
Description	Location of use	Specs / BOQ / Drwg ref.	Specified Make & country of origin	Sample / catalogue	Any other information
COMMISSIONING MANAGEMENT & TESTING, ADJUSTING & BALANCING SERVICES	ALL FLOORS		PRIME TECHNOLOGIES L.L.C/DUBAI U.A.E		
Submitted by ARP Signature & date: 	Received by Consultant: 				
Subcontractor Signature & date: 	Signature: 		Date: 16/02/15		
Date submitted:	Approval required within _____ days from date of this submittal.				
<input type="checkbox"/> A - Approved <input type="checkbox"/> B - Approved with comments <input type="checkbox"/> C - Not approved					
CONSULTANTS COMMENTS Ref comments attached.					
For the Consultant: 	Received by ARP: 		Date: 16/02/15		
<input type="checkbox"/> MEP <input type="checkbox"/> Electrical <input type="checkbox"/> Mechanical <input type="checkbox"/> Plumbing <input type="checkbox"/> Fire Protection <input type="checkbox"/> Other					


Project: - Private Villa – Emirates Hills

Client: - M/s. IFFCO

Consultant: - M/s. JRHP

Main Contractor: - M/s. Al Rostamani Pegel LLC

Hvac Contractor: - M/s. Technical & Trading

<b>UCC</b> UrbanCon Trading & Contracting U-292-292-14-MRRE		<b>EZDAN PROJECTS</b>		<b>EHAf</b> CONSULTING ENGINEERS	
<b>Technical Submittal -TS</b>			TS No. UCC-EZD-TS-020	Rev. No. 00	
Originator: RADIANT	Discipline: MECHANICAL	Location: Reman & Mokarabi		Date: 17-Feb-15	
<b>Subject of Submittal:</b> PRE- QUALIFICATION MANUAL - PRIME TECHNOLOGIES					
<b>Enclosure:</b>					
<input checked="" type="checkbox"/> Pre-Qualification of Subcontractor <input type="checkbox"/> Method Statement <input type="checkbox"/> Guarantee <input type="checkbox"/> Certificate <input type="checkbox"/> Project Quality Plan / Procedure <input type="checkbox"/> Calculation Notes <input type="checkbox"/> Test Results <input type="checkbox"/> Others					
Item No.	Item Description	No. of Copies	Remarks		
1	TESTING, ADJUSTING & BALANCING SERVICES - PREQUALIFICATION MANUAL - PRIME TECHNOLOGIES	2 HC + 1 SC			
					
Prepared by: ENGR. AHMED YOUSSEF		Signature:	Date: 17-Feb-15		
Reviewed by: Joseph Macaraig / Thaeer Hamod		Signature:	Date: 18/2/15		
Main Contractor Authorized Signature: Bassam Inaty		Sr. Projects Manager		Date:	
Consultant Received: (EHAf)		Signature:		Date:	
<b>Consultant Resident Engineer's Comments: (EHAf)</b>					
Follow up Comments within attached. 23/2/15					
<input type="checkbox"/> APR - Approved <input checked="" type="checkbox"/> AAN - Approved As NOTED <input type="checkbox"/> RR - Revise & Resubmit <input type="checkbox"/> NA - Not Approved, Rejected					
Consultant RE Signature: (EHAf)		Signature:		Date: 24 FEB 2015	
Received by Main Contractor : (UCC)		Signature:		Date: 24 FEB 2015	

Project: - Palma Ezdan Restaurant

Client: - M/s. Ezdan Restaurant

Consultant: - M/s. Ehaf Consulting Engineers

Main Contractor:-M/s.Urbacon Trading & Cont.

Hvac Contractor: - M/s. Radiant Engineering

Ref : A9-36PKG5/AS/SO/SYS/0511  
Date : 29<sup>th</sup> May 2011



Mr. TOUFIC AL TURK  
SENIOR PROJECT MANAGER

M/s. SYSTEM CONSTRUCT LLC  
P.O.BOX 7516, Abu Dhabi, UAE  
Tel : 02-6433108  
Fax : 02-6433105

**SUBJECT : THIRD PARTY TESTING AND COMMISSIONING (FOR MEP WORKS)**

**PROJECT : ABU DHABI FUTURE SCHOOL PROGRAM – PHASE I - PACKAGE (5)**

Dear Mr. Al Turk,

Reference to the above subject, no objection to appointing prime technologies for testing and commissioning for (MEP) works, subject to submit the following:

- All works are carried out to CIBSE and ASHRAE commissioning codes BSRIA SMACNA and NEBB commissioning guidelines. (forms and procedure work for the above references to be submitted).
- Instruction for air & hydraulic balancing (function – rang – mini – accuracy –recommended calibration).
- Preliminary TAB procedures (i.e. system ready to balance (check list) for HVAC units and built – up units, duct system, pumps, hydraulic pipe system, control system.
- TAB procedures for air system
- TAB procedures for hydraulic system
- The correct rate of flow of fluid at the conditions specified (tolerance) as per contract specification.
- Sequence of operation (philosophy control) for each equipment.
- Method statements particular to project.
- Commissioning program.


The above is for your record, information & necessary action.

Yours faithfully,  
For DEWAN Architects & Engineers

AZIZ SOBHI  
PROJECT DIRECTOR

29/5/2011

CC : Mr. Eyad Abu Mwais / Musanada  
M . Nadeem Zarriny / Morganti  
Mr. P.K. Vineethan / Morganti  
Dewan Head Office / Site Office



Project:-ADFS Programe – Phase I –Package – 5

Client: - M/s. Abu Dhabi Future School

Consultant: - M/s. Dewan

Main Contractor: - M/s. System Construct LLC

Hvac Contractor: - M/s. Thermo LLC



02/2015 15:22 0097142242840 GULF ENGG & CONSULT PAGE 03/03

**الخليج للهندسة والاستشارات**  
**GULF ENGINEERING & CONSULTANTS**

Ref: ATC/377/76 02/02/2015

Al Turath Al Aseel Contracting & Elec. Mech. (LLC),  
Dubai, UAE.  
Fax no. 04-2389101

Dear Sirs,

Project : **FJ-10075 DM Office at Al Quoz.**


Subject : **Approval of Subcontractor for Testing and Commissioning Works.**

With reference to your letter ref. DM/557/L-40/2015 dated 14/1/2015, proposing M/s. Prime Technologies as your subcontractor to carry out the testing and commissioning works for the above mentioned project, please note that, we have no objection for the same subject to the following:

1. Method statement to be submitted.
2. Schedule of program of work.
3. Calibration certificate for equipment.

The above 'no objection' shall in no way invalidate any of your obligation as the main contractor under the contract.

This is for your information and necessary action.

Yours sincerely,  
For Gulf Engineering & Consultants,  
  
Yaser Ali Abbas  
Manager

Copy to: Director of General Projects Dept.  
Head of Projects Construction Section  
Project Liaison Engineer  
Site Office (Fax 04-3396575)  
GEC File

Name	Action	Info	Sign
Mohammed			
Yasser			

تليفون : ٢٣٨٩١٠ / ٢٣٤٥٢٤ / ٢٣٤٦٤٤ (+٩٧١٤) فاكس : ٢٣٤٦٤٤ / ٢٣٤٦٤٤ (+٩٧١٤) ص.ب : ١١٦١٦ دبي - الامارات العربية المتحدة  
www.gulfeng.net موقع الانترنت : بريد الكتروني : gulfeng@eim.ae  
phone : (+9714) 2284195 / 2214524 Fax : (+9714) 2242840 P.O. Box : 11616, DUBAI - UNITED ARAB EMIRATES  
Website : www.gulfeng.net E-mail : gulfeng@eim.ae

Project: - DM Office @ Al Quoz

Client: - M/s. Dubai Municipality

Consultant: - M/s. Gulf Engineering & Consultants

Hvac Contractor: - M/s. Al Turath Al Aseel

**LINDENBERG ANLAGEN**

RUWAI'S HOUSING COMPLEX EXPANSION-PHASE III  
DESIGN AND CONSTRUCTION OF 132/33KV SUB-STATION AT RUWAI'S  
PROJECT NO. 6046  
AGREEMENT NO. 116046C1

**DRAWING/DOCUMENT TRANSMITTAL FORM**

Transmittal No.: DTF-6046-1119 Date: 12-Feb-15 Resp. By: M/s.ADNOC

From: M/s.Lindenberg Emirates LLC To: ADNOC Attn.: Project Manager

Document class  First submission  Second submission  Further Submission

Previous Submittal Ref.: DTF-6046-1071 Date: 05-Jan-2015 Category: S/C Ref: Date:-

Sr.No.	Document No.	Description	Rev.	Copies	Approval Category
01	6046-LE-0073-M-037	Pre-qualification Document of M/s Prime Technologies LLC for Testing, Adjusting & Balancing of HVAC System	01	1+1	B

**CONTRACTOR REVIEW CHECK LIST**

Architectural  Structural/Civil  Mechanical  Electrical  Plumbing  Others

**THIS SUBMITTAL INTENDED FOR**

APPROVAL / COMMENTS  YOUR INFORMATION / RECORDS

AS PER YOUR REQUEST  YOUR NECESSARY ACTION

For Contractor:  
Mr. Ahmed Abdul Majid Project Manager  
NAME DESIGNATION SIGNATURE DATE 12 FEB 2015

For ADNOC:  
 (A) Accepted  (B) Accepted Subject to comments  (C) Incorporate Comments, re-submit before proceeding  (D) Not Accepted

Comments:

- > Previous revision Company comments not complied.
- > Provide Commercial License having Oil and Gas classification and with proposed Testing & Commissioning activity.
- > Provide ADNOC registration.
- > Contractor to follow the specification section 15950 and comply Testing and Commissioning for other services as listed there in.
- > All Method Statement shall be separately submitted following company procedure.

Mr. Saleh Mohamed Al Jafri Project Manager  
NAME DESIGNATION SIGNATURE DATE 23 FEB 2015

PCD-GSC-FMT-055 REV. 0

Project: -132/33kv Substation @ Ruwais

Client: - M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor:-M/s. Lindenberg Emirates LLC

Hvac Contractor: - M/s. Gulfstar Cool LLC

**DESIGN AND CONSTRUCTION OF ADMINISTRATION BUILDING  
FOR GLENELG SCHOOL AT SAS AL NAKHL**

Project No. 7087  
Agreement No. 147007C1

**DRAWING / DOCUMENT TRANSMITTAL FORM**

Transmittal No.: DTF No: 0778 Date: 6-Dec-14 Resp. By: M/S. ADNOC  
From: Nael Energy & General Enterprises Est. To: ADNOC Attn.: Project Manager

Document Class  First Submission  Second Submission  Further Submission

Previous Submittal Ref.: Date: Category: S/C Ref: Date:

Sr. No.	Drawing / Document No.	Description	Rev.	Copies	Approval Category (For ADNOC use)
1	PQNE/7007/53	Prequalification for M/s Prime Technologies Subcontractor for: Testing, Adjusting, Balancing & Commissioning (Mechanical)	00	1 + 2	B

**CONTRACTOR REVIEW CHECK LIST**  
 Architectural  Structural  Mechanical  Electrical  Plumbing  Others

**THIS SUBMITTAL INTENDED FOR**  
 APPROVAL / COMMENTS  YOUR INFORMATION / RECORDS  
 AS PER YOUR REQUEST  YOUR NECESSARY ACTION

For: Nael Energy and General Enterprises Est.

Ms. Fadwa Al Hammami Project Manager Designation 6-Dec-2014 Date

For ADNOC:  
 (A) Accepted  (B) Accepted Subject to Comments  (C) Incorporate Comments re-submit before proceeding  (D) Not Accepted

Comments:  
 > All relevant testing and commissioning method statement shall be reviewed / stamped / approved by M/S prime technologies.  
 > Testing and commissioning team ( prime ) shall be submitted for company approval.  
 > List of the systems which will tested / commissioning by prime shall be provided and as per agreement.  
 > The coordination between prime and systems specialist shall be main – contractor responsibility the same to be clarified in the requested schedule (item -3).  
 > Compliance statement to be submitted for approval.  
 > Complete forms for all listed equipment shall be provided.  
 > Refer to the comments marked.  
 > Missing certificate to be provided.



Mrs. Salwa Jumaa Al Makhmari Project Manager Designation Signature Date 16 DEC 2014

Project: - Administration Bldg. For Glenelg School @ Sas Al Nakhl

Client: - M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor: - M/s. Sixco LLC

Hvac Contractor: - M/s. Nael Energy & General Enterprises Est

**DESIGN AND BUILD OF CIVIL DEFENSE BUILDING  
AT SAS AL NAKHL**

PROJECT NO. 6085, AGREEMENT NO. 116055C1

**DRAWING / DOCUMENT TRANSMITTAL FORM**

Transmittal No.: DTF - 0915 Date: 18.03.15 Resp. By:  
From: Amana Contracting & Steel Buildings Co. W.L.L. To: ADNOC Attn.: Project Manager

Document class  First submission  Second submission  Further submission

Previous Submittal Ref.: Date: Category: S/C Ref: Date:

Sr.No.	Document No.	Description	Rev.	Copies	Approval Category (For Adnoc use)
		Subject : Pre-Qualification Documents of M/s. Prime Technologies LLC			
1	PQD-6055-M03	Pre-Qualification Document of M/s. Prime Technologies LLC Subcontractor for Air Balancing and Noise Level	0	1+2	B


**CONTRACTOR REVIEW CHECK LIST**  
 Architectural  Structural  Mechanical  Electrical  Plumbing  Others

**THIS SUBMITTAL INTENDED FOR**  
 APPROVAL / COMMENTS  YOUR INFORMATION / RECORDS  
 AS PER YOUR REQUEST  YOUR NECESSARY ACTION

For: AMANA - Project Manager  
AYMAN NAFFA NAME 18.03.15 DATE

For ADNOC:  
 (A) Accepted  (B) Accepted Subject to comments  (C) Incorporate Comments, re-submit before proceeding  (D) Not Accepted

Comments:  
 1. Accepted, subject to provide ADNOC registration and Abu Dhabi Municipality Trade License.  
 Refer to comments on the attached sheet.



HASNA AL KATHEER NAME PROJECT MANAGER DESIGNATION SIGNATURE DATE

Project: - Civil Defense Bldg. @ Sas Al Nakhl

Client: - M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor:-M/s. Amana Cont. & Steel Bldgs. Co. W.L.L

Hvac Contractor: - M/s. Amana Cont. & Steel Bldgs. Co. W.L.L

SUBCONTRACTOR APPROVAL FORM																
<b>Section A. Submittal Details</b>		Project No.: J175 - PT-137	Location: BUSINESS BAY	SUBMITTAL REFERENCE: IEM/101/D3/PQ-12	REVISION: 0											
Project Name: Dubai Design District Office Building		Main Contractor: AMANA	MEP Contractor: I.E.M.S	DATE: 22.10.2014												
<b>SUBCONTRACTOR PROPOSAL</b> M/s. PRIME TECHNOLOGIES LLC P.O. Box : 26736, Dubai, UAE Tel No. : 04 3256555 Fax : 04 3234374																
<b>WORK DESCRIPTION</b> Prequalification for Specialists in Testing, Adjusting & Balancing																
ATTACHMENTS	Prequalifications :	<input checked="" type="checkbox"/>	Signed for and on Behalf of I.E.M.S. Name : Z.A. Subhani Sp. Project Manager													
	Others :	<input type="checkbox"/>	Sign: [Signature] Date: 22.10.2014													
<b>Section B. Approval Details</b>																
<table border="1"> <thead> <tr> <th>Consultant Status</th> <th>Comments</th> <th>Authorized Signature</th> </tr> </thead> <tbody> <tr> <td>Approved (A)</td> <td>Refer to attached comments sheet.</td> <td>[Signature]</td> </tr> <tr> <td>Approved as Noted (B)</td> <td></td> <td></td> </tr> <tr> <td>Rejected - resubmit (C)</td> <td></td> <td></td> </tr> </tbody> </table>					Consultant Status	Comments	Authorized Signature	Approved (A)	Refer to attached comments sheet.	[Signature]	Approved as Noted (B)			Rejected - resubmit (C)		
Consultant Status	Comments	Authorized Signature														
Approved (A)	Refer to attached comments sheet.	[Signature]														
Approved as Noted (B)																
Rejected - resubmit (C)																
<table border="1"> <thead> <tr> <th>TAMDEEN Technical Reviewer Status</th> <th>Comments</th> <th>Authorized Signature</th> </tr> </thead> <tbody> <tr> <td>No Objection</td> <td></td> <td></td> </tr> <tr> <td>No Objection w/ Comments</td> <td>SUBMIT PROJECT-SPECIFIC SUBMITTAL, COMPLETE WITH PER. 23/10/14</td> <td>[Signature]</td> </tr> <tr> <td>Objection</td> <td></td> <td></td> </tr> </tbody> </table>					TAMDEEN Technical Reviewer Status	Comments	Authorized Signature	No Objection			No Objection w/ Comments	SUBMIT PROJECT-SPECIFIC SUBMITTAL, COMPLETE WITH PER. 23/10/14	[Signature]	Objection		
TAMDEEN Technical Reviewer Status	Comments	Authorized Signature														
No Objection																
No Objection w/ Comments	SUBMIT PROJECT-SPECIFIC SUBMITTAL, COMPLETE WITH PER. 23/10/14	[Signature]														
Objection																
<table border="1"> <thead> <tr> <th>TAMDEEN Project Manager Status</th> <th>Comments</th> <th>Authorized Signature</th> </tr> </thead> <tbody> <tr> <td>No Objection</td> <td></td> <td></td> </tr> <tr> <td>No Objection w/ Comments</td> <td></td> <td></td> </tr> <tr> <td>Objection</td> <td></td> <td></td> </tr> </tbody> </table>					TAMDEEN Project Manager Status	Comments	Authorized Signature	No Objection			No Objection w/ Comments			Objection		
TAMDEEN Project Manager Status	Comments	Authorized Signature														
No Objection																
No Objection w/ Comments																
Objection																

**RECEIVED**  
12 NOV 2014

Project: - Dubai Design District Office

Client: - M/s. Tecom Investment

Consultant: - M/s. Kling Consult

Main Contractor: - M/s. Amana Cont

Hvac Contractor: - M/s. IEMSC.LLC

Project Logo:	Project Name: Mr. Omar Alfardan Residential Villas in LPC 22 to 25 @ The Pearl Qatar	Form No.: P07-F14 Rev. 0 Feb. 2012
Client:	Project No.: P-360	Contractor:
Discipline:	Discipline: <input type="checkbox"/> Civil / Structural <input type="checkbox"/> Mechanical <input type="checkbox"/> Electrical <input type="checkbox"/> Architect / Interior Design <input type="checkbox"/> Others	
Submittal Type:	Submittal No.: DS-MS-156	Rev.: 1
<input type="checkbox"/> Technical Submittals <input type="checkbox"/> PQP / ITP <input type="checkbox"/> Test Reports <input type="checkbox"/> Design Data <input type="checkbox"/> Certificates	<input type="checkbox"/> Procedures <input type="checkbox"/> Supplier Approval <input type="checkbox"/> Subcon Approval <input type="checkbox"/> Method Statement <input type="checkbox"/> Schedule / Reports	Submittal Date: 28.02.2015 Expected Response Date: No. of Sets: a.) Handcopy: 3 b.) E-copy: 1 Size: A4 Type: CD
Description of Documents: METHOD STATEMENT FOR TESTING, COMMISSIONING & BALANCING OF HVAC EQUIPMENTS. (TAB: PRIME TECHNOLOGY)		
Submitted for: <input type="checkbox"/> Review and Approval <input type="checkbox"/> Re-Submitted for Review & Approval <input type="checkbox"/> For Information & Records		
Prepared by: VISHWANATHAN	Reviewed by: (Contractor Proj. Coordinator or QA/QC) Ahmad Shaidat	Recommended for Submission by: (Contractor P.M.) RAJESH-ABDOU
Remarks: 1) Calibration certificate to all instruments has to be submitted upon conducting a pretest before. 2) All works has to comply with related codes and standards.		
RECEIVED 07 MAR 2015 7.3.15		
Submittal Status: <input type="checkbox"/> A - Approved <input checked="" type="checkbox"/> B - Approved as Noted <input type="checkbox"/> C - Revise and Resubmit <input type="checkbox"/> D - Rejected		
Reviewed by: [Signature]	Approved by: [Signature]	Client Rep. Endorsement (when required):
AEB RE or Sr. Engineer	AEB - PM	

Project: - Omar Al Fardan Palace Pearl- Qatar

Client: - M/s. Omar Al Fardan

Consultant: - M/s. Arab Engineering Bureau

Hvac Contractor: - M/s. Arabian MEP

Contracting W.L.L

<b>KHANSAHEB CIVIL ENGINEERING LLC</b> KEC - DICEC NEW HALLS EXPANSION DATE RECEIVED: 21-SEP-15 LOG REF: 1125		<b>Q6</b> CONTRACT NO: KCE-DICEC-K114-MH-MS-038 Rev.01 DATE: 21-Sep-15	
<b>PROJECT NAME:</b> DICEC - New Halls Expansion (DWTC)		<b>EMPLOYER:</b> DUBAI WORLD TRADE CENTRE (LLC) DWTC	
<b>PROJECT NO.:</b> 11400703005 <b>SECTION:</b> 230593		<b>PROJECT MANAGER/COST CONSULTANT:</b> MACE	
<b>CONSULTANT:</b> Dar Al Handasah		<b>CONTRACTOR:</b> KHANSAHEB CIVIL ENGINEERING LLC	
<b>REQUEST NO.:</b> KCE-DICEC-K114-MH-MS-038 Rev.01		<b>DATE:</b> 21-Sep-15	

**SUBMITTAL FOR APPROVAL OF MATERIALS**

**1. MATERIAL DESCRIPTION (one item only on this form):**  
 Commissioning Management for Testing, Adjusting & Balancing Services  
 (Pre Qualification Document, Method Statement for Air & Water Balancing)

Area of Application: Hall Area & Back of House Areas  
 Drawing Ref.: IFC Drawing - HVAC B.O.Q. Ref. No.:  
 Specification Ref.: Section: 230593 Standards: CIBSE

Attach all relevant technical literature marked to identify relevant description, current Test Certificates, samples as appropriate

**2. MANUFACTURER/SUPPLIER:**  
 Company Name: Prime Technologies  
 Address: P.O Box No. 26736, Dubai UAE  
 Local Agent: Prime Technologies LLC

**3. DELIVERY:**  
 Country of Origin: UAE - Dubai  
 Availability:  Locally Manufactured  Overseas  
 Delivery: Ex-works/ Total Duration [N/A]  
 Estimated Time of Arrival on Site [N/A]  
 Date Material Required on Site [N/A]  
 Latest Date for Order [N/A]

We certify that the above submitted items have been reviewed in detail and are correct and in strict conformity with the contract drawings and specifications except as otherwise stated; also that the material sources indicated above have been checked in detail and that they will supply the submitted items in conformity with the above and deliver same timely.

Submitted by: Mr. Ben Fowler - Snr. Project Manager Signature: [Signature] DATE: 28/9/15

**4. ENGINEER'S COMMENTS:**  
 \* Tools & instruments used in the site shall have a valid Calibration Certificate at the time of testing.  
 A Method Statement is to be submitted separately, not in a material's submittal.

Signature: [Signature] DATE: 28/9/15

Project : - Dicec New Exhibition Halls @DWTC

Client: - M/s. DWTC

Consultant: - M/s. Dar Al Handasah

Main Contractor: - M/s. Khansaheb Civil Engineering

Hvac Contractor: - M/s. Trans Gulf Electromech

<b>AECOM</b> دار الإشارات للمقاولات العامة ذ.م.م. Construction General Contracting House Ltd	
<b>SUBMITTAL REVIEW</b> DATE: 24 January 2016 Doc. No. AMS-CGCH/EL-POL-007/6 Rev. 0 Related Material Sample No. [Blank] TITLE: Pre-qualification for Testing and Balancing	
TO BE REVIEWED BY: <input type="checkbox"/> ALDAR <input checked="" type="checkbox"/> AECOM	
TYPE OF SUBMITTAL: <input type="checkbox"/> Material Submittal <input type="checkbox"/> Material Sample <input type="checkbox"/> Method Statement <input checked="" type="checkbox"/> Pre-qualification <input type="checkbox"/> Reports <input type="checkbox"/> Operational Procedures <input type="checkbox"/> Operational Maintenance Manual <input type="checkbox"/> Others:	
DISCIPLINE: <input type="checkbox"/> Architectural <input checked="" type="checkbox"/> MEP <input type="checkbox"/> Health & Safety <input type="checkbox"/> Structural <input type="checkbox"/> Civil <input type="checkbox"/> Others:	
Company: CGC House Ltd. Sub-con: Nael Energy & General Enterprises Est. Third Party: PRIME Technologies Attachment: Hard copy (2 sets) Description:	
<b>REVIEW COMMENTS</b> Comments by Contractor Sustainability Consultant (CSC):	
Name: [Blank] Signature & Stamp: [Blank] Date: [Blank] <input type="checkbox"/> A- Approved <input type="checkbox"/> B- Approved with Comments <input type="checkbox"/> C- Revise and Resubmit <input type="checkbox"/> D- Rejected <input type="checkbox"/> E- Not Reviewed	
Comments by ALDAR:	
<input type="checkbox"/> A- Approved <input type="checkbox"/> B- Approved with Comments <input type="checkbox"/> C- Revise and Resubmit <input type="checkbox"/> D- Rejected <input type="checkbox"/> E- Not Reviewed	
Name: [Blank] Signature: [Blank] Date: [Blank] Comments by AECOM:	
Please refer to attached sheet for comments [Signature]	
Comments by AECOM POP:	
No objection [Signature] 2016	
Corrections or comments made relative to submittals during this review do not relieve the contractor from compliance with the requirements of The Contract. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions, selecting fabrication processes and techniques of construction, coordinating his work with that of other trades and performing his work in a safe and satisfactory manner.	
<input type="checkbox"/> A- Approved <input type="checkbox"/> B- Approved with Comments <input type="checkbox"/> C- Revise and Resubmit <input type="checkbox"/> D- Rejected <input type="checkbox"/> E- Not Reviewed	
Name: Iskandar Signature: [Signature] Date: 02-02-2016	

Project Name: - Al Mamoura School Abu Dhabi

Client: - M/s. Al Dar

Consultant: - M/s. Aecom

Main Contractor: - M/s. Construction General Contracting House Ltd





Hvac Contractor: - M/s. Nael Energy & General Enterprises Est.

ENGINEERING OFFICE		DOCUMENT TRACKING SHEET	
Project / Facility Title: CONSTRUCTION OF WAREHOUSE AT PVG, NAD ALSHEBA Project Number: FP-102600003 Project Category: WAREHOUSE Description: Third Party for Testing & Commissioning of HVAC System. Document Reference: DCI/AMEP/04/09/00/0316 Date: 3/2/2016			
<b>Originator</b> From: DOLPHIN CONSTRUCTION LLC To: EO-PMD Name of Originator: Mr. Sunish Ramasamy Project Manager: Mr. Magid Lotfy Sr. Projects Manager Sign/Date:			
<b>Central Document Control</b> IN Dept: DD DB OUT (Final): <input type="checkbox"/> Action <input type="checkbox"/> Info Log. No. AFA 26544 Recd. Date: 03 MAR 2016 Proj. No. FP102600003 Recd. Time:			
<b>DESIGN DIVISION</b> Log In Date: 03 MAR 2016 Log Out To: <input checked="" type="checkbox"/> PMD <input type="checkbox"/> CD <input type="checkbox"/> TS <input checked="" type="checkbox"/> LIS <input type="checkbox"/> Others			






Project: - Warehouse At PVG Nad Al Sheba  
 Client: - M/s. Warehouse At PVG Nad Al Sheba  
 Consultant: - M/s. Engineering Office  
 Main Contractor: - M/s. Dolphin Construction  
 Hvac Contractor: - M/s. Arms Electromechanical

Document/Drawing No.		Rev	Description	Copies	Issue
S.No	Document/Drawing No.	Rev	Description	Copies	Issue
1	JP-AMN-MEC-PQL-0003-01	1	Prequalification for Testing and Commissioning for HVAC System	1 Original + 2 Hard Copies	Appl
OPTION 1: M/s. Prime Technologies L.L.C. OPTION 2: M/s. CSA International L.L.C. OPTION 3: M/s. Reef Tech Services L.L.C.					
Sr. Project Manager: Abdo Michael Merheb			Signature:	Date: 10.12.20	Approval St: Consult
<b>Engineer Comments:</b> - No objection for the proposed option 1. - Approved subject to client approval. - Approval details of this project team who will be assigned to this project and arrange for attending interviews with the client representatives for attending to make presentation on the actualities they will perform during the test period.					
For Engineer: MANI JOHN			Signature:	Date: 20	
PM's Comments: For AECOM Mr. Ayman Mahmoud - Resident Engineer			Signature:	Date:	
<b>Amana Receiver's:</b> - Provide compliance statement in the form of Form 5 need and pre-commissioning & Ob need to be arranged to site the project. Provide relevant application certifications from relevant organization related to					

Project: - Juno  
 Client: - M/s. Beta Emirates Investment  
 Consultant: - M/s. Aecom  
 Main Contractor: - M/s. Amana Contracting  
 Hvac Contractor: - M/s. Amana Contracting



<b>EMPLOYER:</b> Jumeirah Park Villas, Package 7A Const. of 226 No. Villas & Infra Works  Jumeirah Park (LLC)		<b>Ref.: No.</b> SUB-STR-042  REV.C <b>Date:</b> 31-01-2016
<b>ENGINEER:</b>  dar al-handasah sharif and partners	<b>CONTRACTOR:</b>  Actco General Contracting Co. LLC	
<b>SUB-CONTRACTOR'S APPROVAL</b>		
<b>1. SUB-CONTRACTOR'S PARTICULARS</b> Company Name : <b>M/s. Prime Technologies LLC</b> Company Line or works : <b>Specialist in Testing, Adjusting and Balancing (HVAC System)</b> Address : <b>P.O.Box: 26736, Dubai - U.A.E, Tel: 04-325 6555; Fax: 04-323 4374</b> The following prequalifying documents should be enclosed : <input checked="" type="checkbox"/> Commercial Register <input type="checkbox"/> Founding Contract <input checked="" type="checkbox"/> Summary of Experience <input type="checkbox"/> Financial Status <input checked="" type="checkbox"/> Present Works <input checked="" type="checkbox"/> Company Staff <input checked="" type="checkbox"/> Company Equipment		
<b>2. SUB-CONTRACTED WORKS</b> Section of the Works : <b>Electric household appliances repair and maintenance, Air condition and refrigeration equipment maintenance and repair, Testing of electrical systems &amp; components and ventilation of cleanroom areas</b> BOQ Items : Total Value of Sub-Contract (in Contract Rates) : Cumulative Value of Sub-Contracted works to-date (in Contract Rates) : Contractor's Representative Name : <b>Eyad Ammoura - Project manager</b> Signature : 		
<b>3. CONSULTANT COMMENTS</b> Refer to attached comments sheet.		

Project: - Jumeira Park Villas Package 7A  
 Client: - M/s. Jumeira Park LLC  
 Consultant: - M/s. Dar Al Handasah  
 Main Contractor: - M/s. Actco Gen. Contg.  
 Hvac Contractor: - M/s. Elmech

<b>PROJECT:</b> Jumeirah Park Villas, Package 7B & C Const. of 190 No. Villas & Infra Works Proj. No. : N 005-050-05A		<b>EMPLOYER:</b> Jumeirah Park <b>JUMEIRAH PARK LLC</b>	<b>Request No.</b> JPV17BRFIMECHU5983 Rev. 0  <b>Date:</b> 27/02/2016
<b>ENGINEER:</b>  dar al-handasah sharif and partners	<b>CONTRACTOR:</b>  Actco General Contracting Co. LLC <b>ACTCO GENERAL CONT. CO LLC</b>		
<b>REQUEST FOR INSPECTION</b>			
We request your attendance to inspect the following works :			
1. TYPE : CLASSIC TRADITIONAL	PHASE: X	VILLA NO.: 37	
2. INSPECTION TIME : 03:30 PM	DATE : 28/02/2016	3/3/16	
3. LOCATION :	Building	Floor	Element
Package	7B		As attached
			Drawing No. EMW/21018/PK7-BMW/001A-L
4. INSPECTION : <input checked="" type="radio"/> First <input type="radio"/> Second <input type="radio"/> Third			
5. PURPOSE OF THE INSPECTION :			
1. Surveying <input type="checkbox"/> Setting out <input type="checkbox"/> Levels <input type="checkbox"/> Verticality	3. Structure <input type="checkbox"/> Formwork <input type="checkbox"/> Reinforcement <input type="checkbox"/> Concreting	5. Architecture <input type="checkbox"/> Blockwork <input type="checkbox"/> Plaster <input type="checkbox"/> Metals <input type="checkbox"/> Woods & Plastics <input type="checkbox"/> Doors & Windows <input type="checkbox"/> Wall Finish	<input checked="" type="checkbox"/> Floor Slab <input checked="" type="checkbox"/> Ceiling <input checked="" type="checkbox"/> Water <input type="checkbox"/> Furniture
2. Earthworks <input type="checkbox"/> Formation <input type="checkbox"/> Sides of Excavation	4. Electro-Mechanical <input checked="" type="checkbox"/> First Fix <input type="checkbox"/> Second Fix		
Others (specify Particular Details) <b>Inspection for Testing and Commission For A/C Units and A/C balancing of Fcu's And Exhaust Fans</b>			
Submitted by : <b>Ammar Shaheen - Project Manager</b>		Signature 	
6. INSPECTION REPORT :			
<input type="checkbox"/> ARCH	Kitchen exhaust fan is excluded		SIGNATURE: 
<input type="checkbox"/> CIVIL	Subject to scheduled performance		
<input type="checkbox"/> STRUCTURAL	Cure as per site condition		
<input checked="" type="checkbox"/> SURVEY	Refer to the attached comments.		
<input type="checkbox"/> ELECTRICAL			
Date/Time of Inspection : 3/3/2016 11:08 AM			
7. ENGINEER'S REPRESENTATIVE'S COMMENTS :			
The works are : <input type="checkbox"/> Approved <input checked="" type="checkbox"/> Approved as Noted <input type="checkbox"/> Rejected			
Signature 		DATE : 07 MAR 2016	

Project: - Jumeira Park Villas Package 7B & C  
 Client: - M/s. Jumeira Park LLC  
 Consultant: - M/s. Dar Al Handasah  
 Main Contractor: - M/s. Actco Gen. Contg.  
 Hvac Contractor: - M/s. Elmech

Appendix 9


**RUWAIS HOUSING COMPLEX EXPANSION, PHASE III  
CONSTRUCTION OF NEW SECONDARY SCHOOL AT RUWAIS**


PROJECT No. 6054  
AGREEMENT No. 116054C2

**DRAWING/DOCUMENT TRANSMITTAL FORM**

Transmittal No.: DTF-2546      Date: 14-Jun-16      Resp. By:

From: ASGC AL SHAFAR CONTRACTING OILFIELD LLC      To: ADNOC      Attn.: Project Manager

Document class:  First submission     Second submission     Further submission

Previous Submittal Ref: DTF-2410    Date: 23-05-2016    Category: C    S/C Ref:    Date:

Sr.No.	Document No.	Description	Rev.	Copies	Approval Category (for Adnoco)
1	PQ-6054-0103	PRE-QUALIFICATION DOCUMENTS OF M/S.Prime Technologies for Testing and Adjusting and Balancing of HVAC Systems & MECHANICAL S-I-S T&C	2	1+1	B

**CONTRACTOR REVIEW CHECK LIST**

Architectural     Structural     Mechanical     Electrical     Plumbing     Others

THIS SUBMITTAL INTENDED FOR APPROVAL / COMMENTS       YOUR INFORMATION / RECORDS AS PER YOUR REQUEST

NECESSARY ACTION

For: **ADNOC**

(A)  Accepted    (B)  Accepted Subject to comments    (C)  Incorporate Comments, re-submit before proceeding    (D)  Not Accepted

Comments:

- As commented previously, the proposed third party (M/s. Prime) shall be responsible for all mechanical system, contractor to revise the submitted T&C plan and compliance statement to include all mechanical system for the proposed third party scope of work.
- Proposed third party for special system such as elevator, firefighting shall be approved by ADNOC.
- Organization chart to be revised to include the proposed engineers and the responsibility for mechanical system.
- Under taking letter for Abu Dhabi commercial Main contractor and proposed third party also.
- Subject to pass the interview for proposed staff.
- Attach valid ISO 9001 certification.

RECEIVED 23 JUN 2016

RECEIVED

SANTHOSH KANDATHIL CHERYAN      Project Manager      NAME      DESIGNATION      SIGNATURE      DATE




Project: - New Secondary School At Ruwais

Client: - M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor: - M/s. Al Shafar Contracting

Hvac Contractor: - M/s. Al Sabbah Electrical, Mechanical Sanitary Cont Est

MAKS		SUB CONTRACTOR APPROVAL REQUEST	
CONTRACT NO.	MIRDIF HOUSING PROJECT	SCAR NO	SPML/MHP/SCAR/MEP/072
CONTRACTOR	SHAPOORJI PALLONJI MIDEAST	REVISION NO	0
Subcontractor	Prime Technologies L.L.C. P.O. Box 26736, Dubai T: 04-325 6555; F: 04-323 4374 www.primetechnologies.ae email: iran@primetechnologies.ae	REVISION DATE	30-May-16
TO : MAKS	FROM : Shapoorji Pallonji Mideast LLC	TITLE	Prequalification for Prime Technologies LLC
Prequalification for Prime Technologies LLC (Specialist in Testing, Adjusting and Balancing)		DISCIPLINE	MEP
Contractor's Representative: 		TITLE	Prequalification for Prime Technologies LLC (Specialist in Testing, Adjusting and Balancing)
Date: 20.05.2016			
Refer to attached comments			
APPROVED NO COMMENTS <input type="checkbox"/>			
APPROVED AS NOTED <input type="checkbox"/>			
NOT APPROVED - RESUBMIT FOR RECORD ONLY <input type="checkbox"/>			
Consultant Representative: 			
Date: 13-6-2016			
20 JUN 2016		18 JUN 2016	




Project: - Midriff Housing Project

Client: - Mr. Abdullah Ahmed Mohammed




Consultant: - M/s. Arif & Bintoak

Main Contractor: - M/s. Shapoorji Pallonji

Hvac Contractor: - M/s. Shapoorji Pallonji



  		
<b>D7 BURJ VIEW ( B+G+6) RESIDENTIAL BUILDING</b> <b>ON PLOT NO. : 673 1289, AL BARSHA SOUTH 3RD DUBAI UAE</b>		
<b>CLIENT</b> MR. HAIDER ABDULREDA ABDULLA ABDULHUSAIN MASHHADI	<b>CONSULTANT</b> GOLDEN SQUARE ENGINEERING CONSULTANTS	<b>CONTRACTOR</b> AL SHAFAR NATIONAL CONTRACTING
<b>REF NO</b> SEM/P-34/SC-02	<b>PROPOSED SUB CONTRACTOR</b>	<b>DATE</b> 05/07/2016
<b>Sub contract</b> <b>3RD PARTY HVAC TESTING &amp; COMMISSIONING</b>		<b>Sub contractor</b> <b>PRIME TECHNOLOGIES</b>
<b>Approval requested by ( date )</b> 05/07/2016	<b>Phone no.</b> 04-3256555	<b>Address</b> Dubai, U.A.E.
<b>Fax no.</b> 04-3234374	<b>Contractor's stamp &amp; sign</b>	<b>Consultant's receipt</b> B Yate & sign
<b>For Consultant's use</b> Approved (subject to comments) <input checked="" type="checkbox"/> Rejected <input type="checkbox"/> Comments: <i>No objection, subject to</i>		
(A) Contractor responsible to follow all Authority regulations project with (B) Client and approved material submitted for the project & permit (C) Contractor to display one Engineer on site & water balance test work to raise the inspection on daily basis for consultant's review & approval. (D) Contractor to submit Method statement for testing & commissioning work (E) Contractor to submit Method statement for testing & commissioning work		
<b>Approved</b> <input checked="" type="checkbox"/> <b>Rejected</b> <input type="checkbox"/> Comments:		
<b>sign &amp; stamp (Client)</b> 15 JUL 2016		

Project: - B+G+6 Residential Building Al Barsha  
 Client: - Mr. Haider Abdulreda Abdulla Abdul  
 Consultant: - M/s. Golden Square Engineering Consultants  
 Main Contractor: - M/s. Al Madar  
 Hvac Contractor: - M/s. Al Shafar National Contracting

<b>29 AUG 2016</b>		  	
<b>KAS-037 GENERAL SUBMITTAL</b>			
<b>Project</b> : City Walk Phase-II	<b>Employer</b> : Meraas	<b>Submittal Ref:</b>	
<b>Engineer</b> : WSP	<b>PM</b> : Morganti	<b>Sub-Contractor Ref:</b>	<b>Date:</b>
<b>Discipline:</b> Civil <input type="checkbox"/> Street <input type="checkbox"/> Mech <input checked="" type="checkbox"/> Elect <input type="checkbox"/> Arch <input type="checkbox"/> General <input type="checkbox"/>		<b>Sub-Contractor Ref:</b>	<b>Date:</b>
<b>Location:</b>		<b>Sub-Contractor Ref:</b>	<b>Date:</b>
<b>LIST OF SUBMITTED ITEMS:</b>			
<b>Item</b>	<b>Description</b>	<b>No. of Copies</b>	<b>Remarks</b>
01	Pre-Qualification for Commissioning Management & Testing, Adjusting & Balancing Services	01	
<b>REF. SPEC(s):</b>			
<b>REF. DRG(s):</b>			
<b>COMPLIANCE STATEMENT</b> The Contractor hereby confirms that the submitted items have been reviewed in detail and are correct and in strict conformance with the Contract Documents.			
<b>Initiator</b> Dheena Name, Signature & date	<b>QA Manager</b> Rajendra Patil Name, Signature & date	<b>Senior MEP Manager</b> Colin Fox Name, Signature & date	
<b>REVIEWER'S COMMENTS</b>			
WSP (STR/ MEP) <input checked="" type="checkbox"/> ARCHITECTS <input type="checkbox"/>			
<i>- Scope of T&amp;C of prime Tech work not include chilled water balancing</i> <i>- Air balancing T&amp;C of fans are to be in prime technologies scope</i> <i>- Work completion schedule to be submitted.</i>			
<b>Name, Signature and date</b> 29-08-16		<b>Name, Signature &amp; Date</b>	
<b>Comments Sheet Attached?</b> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		<b>Comments Sheet Attached?</b> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	
<b>ENGINEER/ EMPLOYER'S REPRESENTATIVE</b>			
<b>Name &amp; Signature</b>		<b>Date</b> 29 08 2016	
<small>Note: The Engineer's approval shall not in any way relieve the Contractor of his obligation under the Contract. The Contractor shall be solely responsible for the soundness and the correctness of the submitted Materials and Documents as per clause 3.1.c of Conditions of Contract (FIDIC 1999)</small>			
<small>Approval Codes: A: No Objection B: No Objection subject to comments C: Objection, Revise &amp; Resubmit D: For information</small>			

Project:-City Walk Phase 2 Mall Project Avenue  
 Client: - Meraas  
 Consultant: - M/s. WSP  
 Main Contractor: - M/s. Al Futtaim Carillion.  
 Hvac Contractor: - M/s. Al Futtaim Engineering



**Ref:** 812/02/02/1/1604445 29/03/2016

M/s. DEC Dynamic Engineering Consultants  
 Post Box No. 79593  
 Dubai.

Tel: No. 04: 2989220  
 Fax No. 04: 2989210

Dear Sirs,

**PROJECT: PJ 10092 – AL THURAYYA ASTRONOMY CENTER**


**Subject: Approval of Third Party For Testing, Balancing & Commissioning of Mechanical System Works**

Further to your letter ref. DEC-PJ10093-ST/0127/SK/DM-16 dated 23<sup>rd</sup> March 2016, kindly be informed of our 'No Objection' for your recommendation to employ M/s. Prime Technologies LLC as Independent Third Party in order to carry out Testing, Balancing and Commissioning of Mechanical System works for the above mentioned project.


The above 'No Objection' shall in no-way invalidate any obligation of the Contractor/Consultant under the contract.

This is for your kind information and appropriate necessary action.


Yours faithfully

  
**ENGR. HAMAD KHALAF AL SABT**  
 HEAD OF PROJECTS CONST. SECTION


cc: Planning and Development Office  
 File/280316  
 Master/as305



(CIPD-COM-F-009)  
 (CIPD-COM-F-007)



رؤيتنا: بناء مدينة مزدهرة توفر فيها الاستدامة رفاهية العيش وقومات النجاح  
 Our Vision: Creating an Excellent City that Provides the Essence of Success and Comfort of Sustainable Living  
 www.dm.gov.ae



Project: - Al Thuraya Astronomy Center

Client: - Dubai Municipality

Consultant: - M/s. Dynamic Engineering Consultant

Main Contractor: - M/s. Al Faisaliyah Contracting

Hvac Contractor: - M/s. Donrite Elec. Mech.

**DAMAC**

Form No.: DMC-FRM-011

**INTERNAL TRANSMITTAL**

**Project** : P021.23 - Akoya Golf Course Community  
**Transmittal No.** : GCC/INT/APV4/MM/gh/342  
**Issue Date** : 8-Aug-2016

S. No	Recipient	Issue Code	Receive Date	Acknowledged by	Signature	Action Remarks
1	Husam Haddad (Manager - MEP)	IFR & IFC	9/8/16	Jdy	[Signature]	
2	Mr. Moussali		14/8/16	Amadca		

Please find attached the following items as listed below:

ITEM No.	DOCUMENT REF.	REV.	DESCRIPTION	Attachments	
				Copy	Media
1	Transmittal Advice No. 0411 (SUB-MEP-007)	0	Prequalification for 3rd party for HVAC testing, Adjusting & balancing	Original	HC

Damac MEP  
 No objection subject to comply with project specification, international standards & consultant comments.  
 Method statement & check lists to be submitted for consultant approval.  
 08/08/2016

**Legend:** IFI - Information IFR - Review/Signature IFX - Action  
**Issue Codes:** IFC - Comments IFA - Approval/Signature IFF - Records

**Issued by**  
 Name : Mohamad Moussali - Senior Manager- Projects  
 Signature : [Signature]  
 Date : 4-Aug-16

Note: For review/approval: this shall be returned to Originator once completed

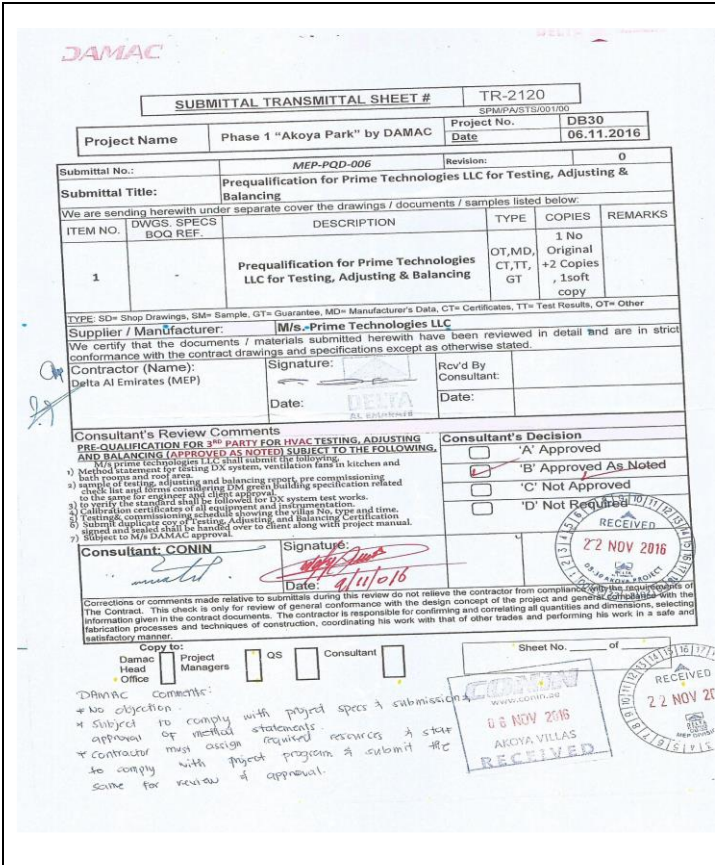
Project: - Akoya Park Villa – Golf Course

Client: - Damac

Consultant: - M/s. Conin

Main Contractor: - M/s. Al Rekha Gen. Cont.

Hvac Contractor: - M/s. Al Jadeed Engineering



**SUBMITTAL TRANSMITTAL SHEET # TR-2120**  
Project Name: Phase 1 "Akoya Park" by DAMAC  
Project No. DB30  
Date: 06.11.2016

**Submittal Title:** Prequalification for Prime Technologies LLC for Testing, Adjusting & Balancing

ITEM NO.	DWG. SPECS BOQ REF.	DESCRIPTION	TYPE	COPIES	REMARKS
1		Prequalification for Prime Technologies LLC for Testing, Adjusting & Balancing	OT, MD, CT, TT, GT	1 No Original +2 Copies, 1soft copy	

**Consultant's Review Comments:**

PRE-QUALIFICATION FOR 3<sup>rd</sup> PARTY FOR HVAC TESTING, ADJUSTING AND BALANCING (APPROVED AS NOTED) SUBJECT TO THE FOLLOWING:

- For prime contractor to submit the following:
  - Method statement for testing & balancing report pre commissioning both existing and new units.
  - Method statement for testing & balancing report pre commissioning both existing and new units.
  - Check list and forms considering DM plan, building specification related to the same for engineers and client approval.
  - To verify the standard shall be followed by the system test works.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.
  - Finalize and submit the certificate of all equipment and instrumentation.

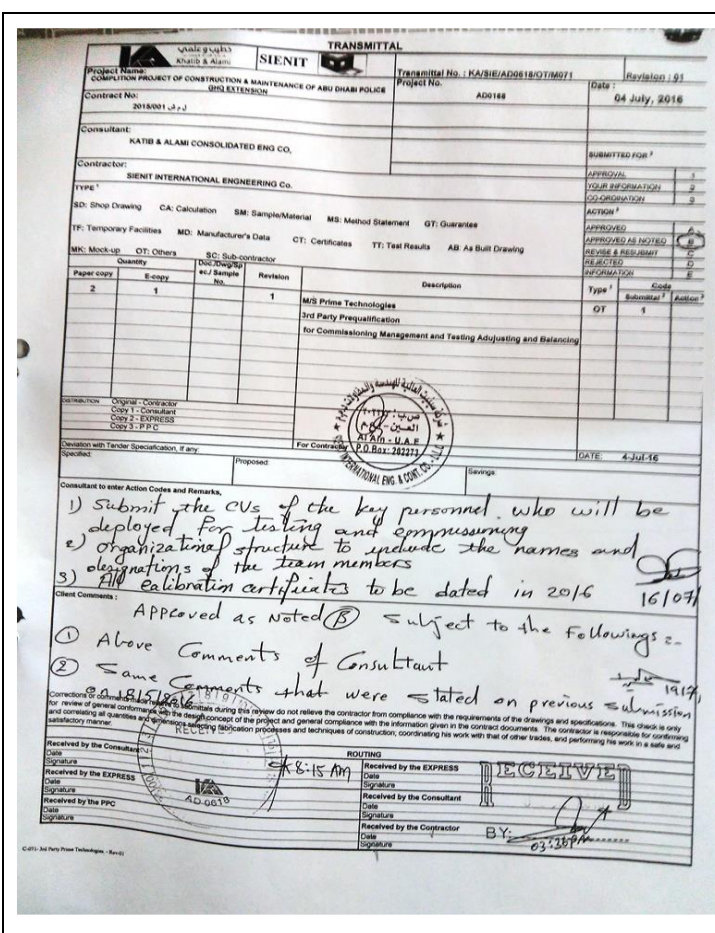
**Consultant's Decision:**

- 'A' Approved
- 'B' Approved As Noted
- 'C' Not Approved
- 'D' Not Approved

**Dynamic Comments:**

- No objection.
- Subject to comply with project spec & submission.
- Approval of method statements, required resources & start.
- Contractor must assign to comply with project program & submit the same for review & approval.

**Project:** - Al Thuraya Astronomy Center  
**Client:** - Dubai Municipality  
**Consultant:** - M/s. Dynamic Engineering Consultant  
**Main Contractor:** - M/s. Al Faisaliyah Contracting  
**Hvac Contractor:** - M/s. Donrite Elec. Mech.



**TRANSMITTAL**  
Project Name: Completion Project of Construction & Maintenance of Abu Dhabi Police Gen. Headquarters  
Contract No. AD0164  
Project No. AD0164  
Date: 04 July, 2016

**Consultant:** Khatib & Alami Consolidated Eng. Co.  
**Contractor:** SIENT International Engineering Co.

**Type:** SD: Shop Drawing, CA: Calculation, SM: Sample/Material, MS: Method Statement, GT: Guarantee

**Action:** APPROVED AS NOTED (B)

**Consultant to enter Action Codes and Remarks:**

- Submit the CVs of the key personnel, who will be deployed for testing and commissioning.
- Organizational structure to include the names and designations of the team members.
- All calibration certificates to be dated in 2016.

**Client Comments:** Approved as noted (B) subject to the followings:-

- Above Comments of Consultant
- Same Comments of Consultant

16/10/16

APPROVED AS NOTED (B)

**Project:**-Abu Dhabi Police Gen. Head Quarters  
**Client:** - Abu Dhabi Police Gen. Head Quarters  
**Consultant:** - M/s. Khatib & Alami  
**Main Contractor:** - M/s. Sient International  
**Hvac Contractor:** - M/s. Afaq Al Madina Technical Services LLC

**FOUNDATION** PROJECT: **POST OFFICE TOWERS**

EMPLOYER: FOUNDATION PROPERTY MANAGEMENT DATE: 18-Jan-16  
 LEAD CONSULTANT: ARCHIGROUP SUBMITTAL NO.: AMSCAD/CI1402/MEP / SUB / 008 / REV 0  
 MAIN CONTRACTOR: ALI MOOSA AND SONS CONTRACTING SHEET: 1 of 1

**TECHNICAL SUBMITTAL**

WE ARE FORWARDING HEREWITH  UNDER SEPARATE COVER  THE DOCUMENTS / MATERIALS LISTED BELOW

THIS SUBMITTAL IS INTENDED FOR:  APPROVAL / COMMENT  INFORMATION / RECORD  KEEP FOR YOUR REQUEST ONLY

SUBJECT:  MATERIALS  CALCULATIONS  PRE-QUALIFICATION  
 SHOP DRAWINGS  REPORTS  GUARANTEE / WARRANTY  
 METHOD STATEMENTS  CERTIFICATES  OTHERS

ITEM NO.	DOCUMENT NUMBER / DRAWING NUMBER	GENERAL DESCRIPTION & REVISION DETAILS	COPIES	APPROVAL STATUS
1	SUB / 008 / REV 0	Pre-qualification Submittal of Commissioning Management and Testing, Adjusting & Balancing Services (Specialist Commissioning Agency) (Prime Prime Technologies LLC.)	2 Hard Copies 1 Soft Copy	

RECEIVED 23 JAN 2016  
 BY: *[Signature]* TREND

Refer to and follow the comments on the attached sheet of on the P.O.

Project:- Post Office Tower Abu Dhabi  
 Client: - Foundation Property Management  
 Consultant: - M/s. Arch group  
 Main Contractor: - M/s. Al Moosa & Sons Cont.  
 Hvac Contractor:-M/s. Trends Electromech LLC

**JAMAC AKOYA CONIN PIVOT**

**SUBMITTAL TRANSMITTAL SHEET # 005**

Project Name: 174 Villas for Calero, Phoenix, Longview and Field Park at Akoya Park Project No.: P-119-P122  
 Date: 26-01-2017

Submittal No.: AKOYA-TR-PQF-MEP-005 Revision: 01  
 Submittal Title: Third Party Testing & Balancing – Method Statement.

ITEM NO.	DWGS. SPECS BOQ REF.	DESCRIPTION	TYPE	COPIES	REMARKS
1		Third Party Testing & Balancing Method Statement.	MD	1 Original + 02 Copies	

TYPE: SD= Shop Drawings, SM= Sample, GT= Guarantee, MD= Manufacturer's Data, CT= Certificates, TT= Test Results, OT= Other

Supplier / Manufacturer: We certify that the documents / materials submitted herewith have been reviewed in detail and are in strict conformance with the contract drawings and specifications except as otherwise stated.

Contractor (Name): Eng. Tarek Abdel Hameed Project Manager  
 Signature: *[Signature]* Date: 26/01/2017

Consultant's Review Comments: **METHOD OF STATEMENT FOR TESTING, ADJUSTING & BLANCING SERVICES APPROVED AS NOTED SUBJECT TO:**

- The approval are only for testing and pre-commissioning of HVAC work along with temperature measurements and final commissioning are subject to permanent power.
- Contractor are fully responsible to obtain DM approval regarding the green building requirements and notes for HVAC system.
- Contractor responsible to provide warranty and guarantee for each Electrical Equipment's regardless the generator voltage regulator should be provided.
- The snags and re-snags shall be still valid and contractor responsibility to provide SIR for closing snags works before handover to client ASAP.
- Final approval subject 'C' & 'C', report approval by Mr. DAMAC, third party.

Consultant: CONIN Signature: *[Signature]* Date: 26/01/2017

Consultant's Decision:  'A' Approved  'B' Approved-As Noted  'C' Not Approved  'D' Not Required

Copy to: Damac Head Office  QS  Consultant

RECEIVED 07 FEB 2017 P 119-10-P122

RECEIVED 26 JAN 2017 AKOYA VILLAS

Project: - 174 Villa Akoya Park Villa  
 Client: - Damac  
 Consultant: - M/s. Conin  
 Main Contractor: - M/s. Al Rekha Gen. Cont.  
 Hvac Contractor: - M/s. Pivot Engineering & Gen. Cont. Co.LLC

**PRE QUALIFICATION SUBMISSION** *0452* File Ref / 6.18

Project Name: Dubai College Modification Sub Ref No. 3401B/PRE/AC/001 Rev 0  
 Client: Dubai College Date: 26.03.2017  
 Main Contractor: Jasaf Building Technology Co. Response Status:  Normal  Urgent  
 Sub Contractor: \_\_\_\_\_

**Description**  
 Description: Testing and Commissioning Prequalification Manual  
 Purpose: \_\_\_\_\_  
 Specified: Yes / No: Yes Specification Ref.: \_\_\_\_\_  
 Manufacture / supplier: Prime Technologies  
 Reason for alternative: \_\_\_\_\_  
 BOQ Reference: \_\_\_\_\_  
 Enclosures: Material Submittal 1 No.

Signature: *[Signature]* Date: *26.03.2017*  
 For Main Contractor

**Comments**  
*"Prime technologies" is accepted as testing/commissioning contractor for hvac systems however contractor do submit organization chart and CV of team who stpl be on this project.*

Confirmed by: ARCHITECTURAL STRUCTURAL MEP  
 Signature: *[Signature]*  
 Name: *AVINASH*  
 Date: *31/3/17*

**The Document is**  
 Code A  Code B  Code C

No objection Re-submission not required  
 No objection subject to addressing comments (work may proceed) Re-submission required  
 Rejected (work may not proceed) Re-submission required

NOTES -> This document is to be read in conjunction with the relevant Contract Conditions; All submissions are to be typed; Hand written submissions will not be accepted.

SF 45 V4.0 Dubai / Abu Dhabi / Sharjah PO Box 7185 Dubai T +971 4 3237555 E mail@ga-use.ae  
 Architecture / Interior Design United Kingdom United Arab Emirates F +971 4 3237717 W www.ga-use.ae Page 1 of 1

Project: - Dubai College Admin Bldg.& Service  
 Client: - Dubai College  
 Consultant: - M/s. Godwin Austen Johnson  
 Main Contractor: - M/s. Jasaf Bldg. Technology  
 Hvac Contractor: -M/s. Jasaf Electromechanical

**PR-Qualification Transmittal**

Reference: DJ-218-P-CHSS-HVAC-PQL-9004-00 Date: 03-May-2017 Total No. of Pages: 1  
 From (Company): Amana Steel Building & Contracting LLC To: CHSS Engineering Consultants  
 Name: Abdulrahman Al Najjar Name(s): Hadi El Fakhry  
 Designation: Project Manager CC: Suhail Arjomand

Project: Warehouse Phase III DIC Project No. PT - 164  
 Subject: Prequalification For HVAC Testing and Commissioning External Project Manager: N/A  
 Project Owner: Dubai Industrial City Project Manager: N/A

Please find attached of the following documents:

S. No.	Document Ref. No.	Name/Description	Rev.	No. of Copies	Digital Copy
1.		Prequalification Submission - Third Party Testing for HVAC Testing and Commissioning - Prime Technologies L.L.C.	00	2	<input checked="" type="checkbox"/> Included

Trades/Services:  Architectural  Civil/Structural  M.E.P.  Other (specify): \_\_\_\_\_

The above item(s) are for action as marked below:  
 Comment  Approval  Information  Action  Signature  Other (specify): \_\_\_\_\_

**AMANA:**  
 Name: Moomen Ahmad Nuair MEP Project Manager Signature: *[Signature]* Date: 03 May 2017  
 Name: Abdulrahman Al Najjar Project Manager Signature: *[Signature]* Date: 03 May 2017

**CHSS Remarks**  
 No objection, subject to performance of M/s Prime and the following:  
 - Testing and commissioning shall be carried out as per project specs in accordance with relevant standards.  
 - Method statement along with test formats and check lists to be submitted for approval.  
 - Calibration certificate for equipment and instruments to be furnished.  
 - Schedule of program of works along with specific organization chart to be submitted.

**CHSS:**  
 Name: Anis Ahmed - Resident Engineer Signature: *[Signature]* Date: *06/05/17*

**CHSS Comment Code**  
 A - Approved  B - Approved with Comment  C - Revise & Resubmit  D - For your information  E - Rejected

**TAMDEEN Remarks**  
*No objection subject Method of statement include both building CFM & Performance parameters. TAMDEEN*

**TAMDEEN:**  
 Name: Suhail Arjomand - Project Manager Signature: *[Signature]* Date: \_\_\_\_\_

**TAMDEEN Comment Code**  
 A - Approved  B - Approved with Comment  C - Revise & Resubmit  D - For your information  E - Rejected

EM-BPM-F-18 REV A Issued 15/03/08 page 1 of 1

Project: - Warehouse Phase 3 At Dic  
 Client: - Dubai Industrial City  
 Consultant: - M/s. Chss Engg.Consultants  
 Main Contractor: - M/s. Tamdeen  
 Hvac Contractor: - M/s. Amana Contracting

**PRE QUALIFICATION SUBMISSION** *0452* File Ref / 6.18

Project Name	Dubai College Modification	Sub Ref No.	3401B/PRE/AC/001	Rev	0
Client	Dubai College	Date	26.03.2017		
Main Contractor	Jasaf Building Technology Co.	Response Status	<input type="checkbox"/> Normal <input type="checkbox"/> Urgent		

**Description**  
 Description : Testing and Commissioning Prequalification Manual  
 Purpose :  
 Specified : Yes / No : Yes Specification Ref. :  
 Manufacture / supplier : Prime Technologies  
 Reason for alternative :  
 BOQ Reference :  
 Enclosures : Material Submittal 1 No.

Signature : *[Signature]* Date: *26.03.2017*  
 For Main Contractor

**Comments**  
*"Prime technologies" is accepted as testing/commissioning contractor for hvac systems however contractor do submit organization chart and CV of team who shall be on this project.*

Confirmed by: ARCHITECTURAL STRUCTURAL MEP  
 Signature: *[Signature]*  
 Name: *AVINASH*  
 Date: *31/1/17*

**The Document is**  
 Code A  Code B  Code C

No objection Re-submission not required  
 No objection subject to addressing comments (work may proceed) Re-submission required  
 Rejected (work may not proceed) Re-submission required

NOTES -> This document is to be read in conjunction with the relevant Contract Conditions; All submissions are to be typed; Hand written submissions will not be accepted.

SF 45 V4.0 Dubai / Abu Dhabi / Sharjah PO Box 7185 Dubai T +971 4 3237555 E mail@gai-use.ae  
 Architecture / Interior Design United Kingdom United Arab Emirates F +971 4 3237717 W www.gai-use.ae Page 1 of 1

Project: - Dubai College Admin Bldg.& Service  
 Client: - Dubai College  
 Consultant: - M/s. Godwin Austen Johnson  
 Main Contractor: - M/s. Jasaf Bldg. Technology  
 Hvac Contractor: -M/s. Jasaf Electromechanical

**PR-Qualification Transmittal**

Reference	DJ-218-CHSS-HVAC-PQL-0004-00	Date	03-May-2017	Total No. of Pages	1
From (Company) Name	Amana Steel Building & Contracting LLC	To (Company) Name(s)	CHSS Engineering Consultants		
Designation	Abdulrhman Al Najjar Project Manager	Name(s)	Hani El Fakhry Suhail Ajomand		

Project: Warehouse Phase III DIC  
 Subject: Prequalification For HVAC Testing and Commissioning  
 Project Owner: Dubai Industrial City  
 Project No.: PT - 164  
 External Project Manager: N/A  
 Project Manager: N/A

Please find attached of the following documents:

S. No.	Document Ref. No.	Name/Description	Rev.	No. of Copies	Digital Copy
1.		Prequalification Submission - Third Party Testing for HVAC Testing and Commissioning - Prime Technologies L.L.C.	00	2	<input checked="" type="checkbox"/> Included

Trades/Services:  Architectural  Civil/Structural  M.E.P.  Other (specify):

The above item(s) are for action as marked below:  
 Comment  Approval  Information  Action  Signature  Other (specify):

**AMANA:**  
 Name: Moamen Ahmad Nuair  
 MEP Project Manager  
 Signature: *[Signature]* Date: 03 May 2017  
 Name: Abdulrhman Al Najjar  
 Project Manager  
 Signature: *[Signature]* Date: 03 May 2017

**CHSS Remarks**  
 No objection, subject to performance of M/s Prime and the following:  
 - Testing and commissioning shall be carried out as per project specs in accordance with relevant standards.  
 - Method statement along with test formats and check lists to be submitted for approval.  
 - Calibration certificate for equipment and instruments to be furnished.  
 - Schedule of program of works along with specific organization chart to be submitted.

**CHSS:**  
 Name: Anis Ahmed - Resident Engineer  
 Signature: *[Signature]* Date: *06/05/17*

**CHSS Comment Code**  
 A - Approved  B - Approved with Comment  C - Revise & Resubmit  D - For your Information  E - Rejected

**TAMDEEN Remarks**  
*No objection*  
*Submit Method of Statement*  
*include new CFM & Performance Parameter*  
*for both building A & warehouses.*

**TAMDEEN:**  
 Name: Suhail Ajomand - Project Manager  
 Signature: *[Signature]* Date: *03 May 2017*


**TAMDEEN Comment Code**  
 A - Approved  B - Approved with Comment  C - Revise & Resubmit  D - For your Information  E - Rejected

APPROVED AS NOTED  
 RECEIVED  
 03 MAY 2017  
 RECEIVED  
 PT-164 WH PHASE III  
 4/5/17 9:10


EM-SPM-F-18 REV A Issued 10/03/08 page 1 of 1

Project: - Warehouse Phase 3 At Dic  
 Client: - Dubai Industrial City  
 Consultant: - M/s. Chss Engg.Consultants  
 Main Contractor: - M/s. Tamdeen  
 Hvac Contractor: - M/s. Amana Contracting


174 / PSC-111



DC Middle East Contracting Co. L.L.C.  
P.O. Box: 202000, Dubai, U.A.E.



AINONA  
ENGINEERING CONSULTANTS



ADCE  
Abu Dhabi Commercial Engineering Association

**SUB CONTRACTORS APPROVAL FORM**

Project Name: AL SHEKH HAMAD SALEM AHMAD BAL RAKAD AL AMERI PLOT: RBW5-02, SHAYTE AL RAHA BEACH, ABU DHABI. File No: 44  
 Consultant: BAINONA ENGINEERING CONSULTANCY Ref No: PQ-38-502 (Rev. 0)  
 Contractor: MAIN - AL DIYARI MEP - GULF COAST Date: 14.05.2017

Type of Work: **Prequalification for Prime Technology (Balancing Services for HVAC System)** (Testing Adjusting and)

Sub Contractor Name: Prime Technologies L.L.C.

Company Profile Contents:  prequalification  valid trade license  organization chart  previous approvals

CONTRACTOR: Prime Technology will work under the supervision of the Contractor Gulf Coast Electromechanical Co.

Originator of the submittal/ Eng.: Al Diyar Mr. Eng. Mohamed... Mob. No: 955-5963358  
 Contractor Authorizes signature: [Signature] Date: 14.05.2017

**CONSULTANT COMMENTS:**

- 1- No objection for Prime technology as third party for Testing/ Commissioning of HVAC system.
- 2- submit organization chart for dedicated staff/Engineer for pre
- 3- submit method statement for T/A procedure
- 4- follow up the project specification/ regulation and standard
- 5- submit testing and commissioning forms for approval
- 6- submit List of staff/Engineer of calibration certificate
- 7- submit ADCE registration certificate

Approval Status:  A: Approved  B: Approved as noted  C: Revise & Resubmit  D: Not Approved

Reviewer of the submittal/ Eng.: [Signature] Mob. No.:  
 Consultant Authorizes signature: [Signature] Date: 17-05-2017

ADCE (Abu Dhabi Commercial Engineering) Received

\* Complete TSC report to be submitted  
 \* Estidama FCR to be submitted

A: Approved  B: Approved as noted  C: Revise & Resubmit  D: Not Approved

\* Registration with ADCE is required Date: 7-6-17

All the supportive documents must be presented and filed at project site.  
 (\* Approval does not relieve the Contractor from his contractual obligations and responsibilities)

RECEIVED  
19 JUN 2017

AINONA  
Project: 304 Plot No RBW 5-02  
Al Raha Building

16 MAY 2017

RECEIVED  
Job No.: 2281

Project:-Rbw5-02 Al Raha Beach – Abu Dhabi

Client: - Adce

Consultant: - M/s. Bainona Engineering Consultancy

Main Contractor: - M/s. Al Diyar

Hvac Contractor: - M/s. Gulf Coast

**MATERIAL APPROVAL REQUEST**

PROJECT TITLE: 3B+G+4 FLOORS +ROOF +TOP ROOF HOSPITAL BUILDING ON PLOT NO.2410413 FOR ADNAN KHAMIS MOHAMED OBAID ALTAYANI, ZULEKHA IQBAL DAUD & ZANUBIA DAUD SHAMS, AT AL NADHA SECOND CITY, DUBAI - U.A.E

<b>ARCHITECTS:</b> DC Middle East Contracting Co. L.L.C.	<b>MEP CONSULTANTS:</b> IAN BANHAM & ASSOCIATES	<b>MAIN CONTRACTOR:</b> [Logo]	<b>MEP CONTRACTOR:</b> Jamaheer Construction LLC
---	--	-----------------------------------	---

Contract document Ref No: J168/M/AC-46  
 D.A.R. No.:  
 Date: 27-July-17  
 Rev: 00

**Material Description:**  
 PREQUALIFICATION FOR THIRD PARTY TESTING AND COMMISSIONING

**Material Trade Name:**  
 Listed  Proposed

**Contract Specification Details:**  
 Location / Area of Use: HVAC Systems  
 Technical Details of proposed materials:  
 N/A

**List of Enclosures:**  
 Compliance statement  
 Samples submitted  
 Original Brochure  
 Other supporting document (if any): Yes  
 Group / Local Agent: M/s. Prime Technologies LLC  
 Country of Origin: U.A.E

**Submitted by:** [Signature] Sign & Date: [Date]  
**Received by SECL:** [Signature] Sign & Date: 29 JUL 2017  
**Received by IBA:** [Signature] Sign & Date: 29 JUL 2017

**EMPLOYER / CONSULTANT Approval Status / Comments**

Approval Code- (A) <input type="checkbox"/> Approved	Approval Code- (B) <input checked="" type="checkbox"/> Approved with Comments	Approval Code- (C) <input type="checkbox"/> Incorporate Comments, Revise and Resubmit	Approval Code- (D) <input type="checkbox"/> Not Approved
---	--	--	---

**Comments:**

- PQ IS ONLY FOR HVAC, & WATER SERVICES.  
 - INCLUDE +IVE & +IVE REGULAR REQUIREMENTS FOR HVAC.

**Returned by IBA:** [Signature] Sign & Date: 30.07.17  
**Received by DC:** [Signature] Sign & Date: 31 JUL 2017  
**Received by SECL:** [Signature] Sign & Date: 31 JUL 2017  
**Received by IBA:** [Signature] Sign & Date: 31 JUL 2017

The Engineers Representative review, comments and approval to the submittal is for general conformance with the design concept and specifications shall not relieve the contractor from responsibility for any deviations from, or omissions in respect of the requirements of the contract documents unless the contractor has informed the Engineer in writing of specific deviations and Engineer has given written approval thereto.

Project: - Zuleika Hospital

Client: - Zuleika Hospital

Consultant: - M/s. Ian Banham & Associates

Main Contractor: - M/s. Sobha Engineering

Hvac Contractor:-M/s. Jamaheer Constructions

Dubai Metro  
Union Square Baniyas Road  
Dubai  
0000 United Arab Emirates



JT METRO JV  
JAPAN-TURKEY  
METRO JOINT VENTURE  
PO Box 182845  
Tel: +971 4 221 2121  
Fax: +971 4 221 2181

Reference No: SR-000423  
**LETTER-019585**

**Letter**

To: Mr Bidyut Chattopadhyay - ETASET  
Cc (17): Mr Ankur Mahindra - ETASET (ankur@etasetjv.ae) (16 more...)  
From: Mr Kotaro Nonaka - JT Metro JV  
Sent: Tuesday, 2 September 2008 3:12:04 PM GST (GMT + 04:00)

Attribute 1: Civil  
Phase 1 - Red Line  
Phase 2 - Green Line  
TL Civil Construction  
TL Quality Assurance

Attribute 2: 2.11 M & E  
Status: Overdue  
Response: Respond by 08/09/2008  
Subject: EMM -Prequalification Manual for Building Service Commissioning Management- Engineer Response

Dear Sir,

We refer to your Letter-001042 regarding your Prequalification Manual for Building Service Commissioning Management (Prime Technologies LLC).  
The Engineer has **No Objection on the company** proposed; however, the following comments/documents should be addressed/submitted for the Engineer's review to receive the status of "No Objection":

- Proposed Equipment list for the works including (Type, Model, Year of Manufacture, Condition, Ownership status, date of mobilization and current location) to be submitted
- Proposed Manpower/resources list for the works to be submitted
- Confirmation if the Elevators, escalators and travelators are within the scope of works or not.
- Experience with SCADA system is very limited as per the CVs attached
- Proposed Time Schedule for the works to be submitted.

This for your information and necessary action

Yours faithfully,

**Kotaro Nonaka**  
Deputy Project Director  
**JT Metro JV**

IT/CL/rv  
End.

From: Mohammed Hassan  
Sent: 20/08/2008 04:54:01 PM GST (GMT + 04:00)  
To: Shurichi Shimamura; Sabah Al Ghini; Adnan Ahmed Al Hamma; Montazer Al Farouk; Ali Hasan Ali Al Mansoori; Husain Hassan Aldosary; Abdusamee

Project:-Dubai Metro Red Line  
Client: - M/s. RTA  
Consultant: - M/s. Syatra / Parsons  
Main Contractor: - M/s. JTM.JV  
Hvac Contractor: - M/s. ETA SET

337

**ARENCO** ABDULLAH AHMED ALMOOSA  
architectural & engineering consultants

16/12/13 Mr. Jamal  
HCC 4/13/13

JOB # : 2014  
REF # : I662/MW/AC-27

**APPROVAL OF SUBCONTRACTOR / SUPPLIER**

Project Name : G+1 POLICE STATION BUILDING FOR DUBAI POLICE FORCE  
Plot No. : 599-1270 Location : JEBEL ALI City : DUBAI  
Main Contractor : AL HOSNEI CONECTRACTING LLC  
Department :  Architectural  Structural  
Subcontractor (Proposed): **M/S Prime Technologies (Testing and Commissioning subcontractor)**

ARENCO Specified Subcontractor / Supplier  
Sullton International,CML,Prime Technologies,I to i  
Proposed Subcontractor / Supplier  
**Prime Technologies**

Manufacturer : N/A  
Local Agent : N/A  
Enclosures : COMPANY PROFILE  
Reason(s) for Alternative Subcontractor / Supplier :  
Submitted by : Vinline Desilva Signature: [Signature] Date: 13/12/2012

ARENCO (S.C.)  
NO OBJECTION TO SUBCONTRACTOR AS NOTED  
28 JAN 2013  
SIGN: [Signature]

This portion is for the use of Consultant only  
Status  Approved  Approved As Noted  Rejected  Resubmit

Comments : subject commissioning engineer for interior & to inspect measuring tools

Signed by: [Signature] Date: 28/1/13  
This form is to be handed over to ARENCO early enough. Sometime, approval may take upto two weeks.

Approved [Signature] 28/12/2013 [Signature] 4/13/2013

Project: - Jabel Ali Police Station  
Client: -Govt. of Police Force  
Consultant: - M/s. Arenco Consultant  
Main Contractor: - M/s. Al Hosnei Cont.LLC  
Hvac Contractor:-M/s.Mechwatt  
Electromechanical

Document 27 AUG 2014  
**Transmittal**  
**Kitco Contracting**

Project Title : Tawar Mall  
 Client : Mr. Jabar Sultan Al Kuwari  
 Consultant : ACQ  
 Contractor : Kitco Contracting

Submittal Ref No : DT - MEP - 016  
 Revision : 01  
 Date of Submittal : 26/06/2014

SR #	Description of Document	No of copies
1	PRE QUALIFICATION DOCUMENT OF PRIME TECHNOLOGIES FOR TESTING, ADJUSTING AND BALANCING SERVICES	1

Prepared by :  
 Date: \_\_\_\_\_ Signature: \_\_\_\_\_  
 Reviewed by Project Manager: Name: NA Signature: \_\_\_\_\_  
 Approved for Submittal by HD.MECH: Name: MOHAMMED ABUL WAHAB Signature: 26/8/14  
 For Use By Consultant: Comment: APPROVED AS NOTED See attached Comment sheet.

Consultant Name: RANBARWAH Signature: \_\_\_\_\_ Date: 2/9/14  
 Received By (contractor) - One copy with Attachment: Name: \_\_\_\_\_ Signature: \_\_\_\_\_ Date: \_\_\_\_\_  
 Subcontractor Ref: \_\_\_\_\_ Date: 03 SEP 2014  
 Section reserved for (contractor) use only : \_\_\_\_\_

Project:- Tawar Mall

Client: - M/s. Mr. Jabar Sultan Al Kuwari

Consultant: - M/s. Architechtual Consulting

Main Contractor: - M/s. Kittco Contracting

Hvac Contractor: - M/s. Arabian MEP Cont..

**ENGINEER'S OFFICE**  
**APPLICATION FOR APPROVAL**

Project Title: Construction of Villas, Kitchen Block and Service Yard at Nad al Sheba 2nd  
 Project No.: P-003911000  
 Client/Management: HHS Ahmed (A) and HHS Rasheed (R)  
 Reference: JBT-MS-AC-0019-1-0014  
 Consultant: Engineer's Office  
 Date: 26.06.2014  
 Contractor: Jasaf Building Technology Co LLC

APPLICATION BY :  CD  LID  ID  FMD  OTHER

CONTRACTOR:  
 This submittal has been reviewed & is considered suitable

NAME	SIGNATURE & DATE
Contractor: Jasaf Building Tech Co LLC	
Engineer In Charge: Akram Mahmoud	AKM 26-06-2014
Approved By: George Demetriou	GD 26/6/14

APPROVAL FOR:  
 DESIGN PROPOSAL  
 PRE QUALIFICATION  
 MATERIAL SUBMITTAL/EQUIPMENT  
 SHOP DRAWINGS  
 SAMPLE  
 METHOD STATEMENT  
 TEST REPORT  
 OTHER

TITLE & DESCRIPTION: Villa 'R'  
 LOCATION: Testing & Commissioning for Air Balancing Works  
 ORIGINATED / SUPPLIED BY: Prime Technologies  
 INSTALLED BY: Prime Technologies

CONTRACTORS ATTESTATION  
 CONFIRMS TO SPECS.  ALTERNATIVE - EQUAL/BETTER THAN SPECIFIED  ALTERNATIVE PROPOSAL DUE TO OTHER REASONS - COMPARISON SHEET ENCLOSED

DATE BY WHICH RESPONSE IS REQUIRED: \_\_\_\_\_  
 THE SPECIFIED: Included: Yes  
 REFERENCE TO THE CONTRACT DOCUMENT / B.O.Q ITEM No. / Varies: \_\_\_\_\_  
 GENERAL / PARTICULAR SPECIFICATIONS SECTION & CLAUSE: \_\_\_\_\_  
 DRAWING REFERENCE No: \_\_\_\_\_

EO's REVIEW:  
 1) Performance test report for the outdoor unit of the split A/C unit is not included, the same is missing for the A/C package unit for the compression and condenser. (such as amper, refrigerant pressure)  
 2) air coil temperature should be measured for all A/C units.  
 3) thermostat type format is not included.  
 4) Room temperature measurements against the thermostat set point to be tested.  
 5) Noise level for the room should be measured.  
 6) Refer to our comments marked on the submitted sheets.

REVIEWED BY:	Name	Designation	Sign & Date
	AKM	M.E	AKM 26/6/14
	AKM	SEM	AKM 26/6/14

APPROVED BY:  
 Date: 06 JUL 2014  
 Signature: \_\_\_\_\_

APPROVAL STATUS  A. APPROVED  B. APPROVED AS NOTED  C. RESUBMIT  D. REJECTED

APPROVAL VIDE THIS DOCUMENT SHALL NOT IN ANY WAY RELIEVE THE CONTRACTOR OF HIS RESPONSIBILITIES FROM THE COMPLIANCE TO THE CONTRACT CONDITIONS & THE SPECIFICATIONS NOR ENTITLES HIM FOR ANY VARIATION CLAIM

Project: - Villa A & R Kitchen Block

Client: - HHS Ahamd And HHS Rasheed

Consultant: - M/s. Engineer's Office




Main Contractor: - M/s. Jasaf Building Technology LLC

Hvac Contractor:-M/s.Jasaf Electromechanical





**P028 - LOUVRE ABU DHABI**

SUBMITTAL COVER			
Contract Title:	Main Contract Works	Number:	P028-ASO-230800-PRQ-500001
Contract No:	P028/C39	Type:	Prequalification
Title:	Prequalification Submittal - Testing Adjusting & Balancing Services - HVAC System		
Manufacturer:	Prime Technologies	Location:	Site Wide
Sub Contractor:	Drake & Scull International Habtoor Leighton Speccon-JV	Discipline:	Mechanical
Specification:	230800 & 230801		
Contract Ref:	N/A		
BOQ Ref:	N/A		
Other Ref:	N/A		
Description:	Prequalification Submittal - Testing Adjusting & Balancing Services - HVAC System		
Sustainability Statement:	N/A		
Enclosures:	1) 2) 3) 4)		

SUBMITTAL COMMENTS									
REV	RECEIVED BY EMPLOYER REP	COMMENTS	STATUS					SIGNATURE	
			A	B	C	D	E		
00	BHC -MO - 21st May 2014	Prequal is returned status c as it fails to identify key personnel, provide a Organogram of both site set up and office set up. Also does details proposed resource levels etc				C			BHC -MO - 21st May 2014 ASO
01	BHC-MO-22nd July 2014	Prequal is approved subject to onsite meeting with Key personnel and presentation of methodologies and understanding of the project		B					BHC -MO - 22nd June 2014 ASO BHC
02									ASO BHC

EMPLOYER COMMENTS: \_\_\_\_\_

STATUS CODES:  
 A Approved  
 B Approved with Comments  
 C Review and Resubmit  
 D Reviewed  
 E Rejected

CONTRACTOR DETAILS			
Prepared By:	Kaleel Seraj (CSS)	Reviewed By:	John Mills
Title:	Document Controller	Title:	Project Director
Telephone:	_____		

Project:- Louver Abu Dhabi



Client: - M/s. TDIC

Consultant: - M/s. Buro Happold

Main Contractor:-M/s. ASO - JV

Hvac Contractor:-M/s.Drake&Scull/Al Habtoor

SUB CONTRACTOR APPROVAL REQUEST			
CONTRACT NO.	MIRDIF HOUSING PROJECT	SCAR NO	SPML/MHP/SCAR/MEP/072
CONTRACT TITLE	MIRDIF HOUSING PROJECT	REVISION NO	0
CONTRACTOR	SHAPOORJI PALLONJI MIDEAST	REVISION DATE	30-May-16
Subcontractor	Prime Technologies L.L.C. P.O. Box 26736, Dubai T: 04-325 6555; F:04-323 4374 www.primetechnologies.ae email: imran@primetechnologies.ae	TITLE	Prequalification for Prime Technologies LLC
		DISCIPLINE	MEP
		TITLE	Prequalification for Prime Technologies LLC (Specialist in Testing, Adjusting and Balancing)
TO : MAKS	FROM : Shapoorji Pallonji Mideast LLC		
Prequalification for Prime Technologies LLC (Specialist in Testing, Adjusting and Balancing)			
Contractor's Representative: _____			
Date: 20.05.2016			
Refer to attached comments			
APPROVED NO COMMENTS <input type="checkbox"/>			
APPROVED AS NOTED <input checked="" type="checkbox"/>			
NOT APPROVED - RESUBMIT <input type="checkbox"/>			
FOR RECORD ONLY <input type="checkbox"/>			
Consultant Representative: _____			
Date: 18-6-2016			

Project: - Mirdiff Housing Project

Client:- MAKS

Consultant: - M/s. Arif & Bintoak

Main Contractor: - M/s. Shapoorji Pallonji

Hvac Contractor:-M/s. Shapoorji Pallonji

Eng. Zayed

3 STAR HOTEL AT ALBARSHA FIRST - Dubai									
Client: ABDULLA SAIED AMER HAMAD ALNEYADI		ECG ENGINEERING CONSULTANTS GROUP							
TRANSMITTAL Sub-Contractor Ref.: AIRTECHNIC (DTART/0051)				Ref.:	ATC-DT-AC-ABH-0098				
				Rev.:	0				
				Date:	08/05/16				
Drawings:	Reports:	Schedules:	Calculation:						
Sketches:	Method Statements:	Specification:	Others:						
No.	Drawing / Document no.	Rev.	Description	Bldg.	Floor	Size	No. of Copies	ASTM Code	Status Code
1	DT-0099	0	PREQUALIFICATION DOCUMENT OF TESTING, ADJUSTING & BALANCING OF HVAC SYSTEMS (PRIME TECHNOLOGIES)			A4	2		
									
Authorized Contractor Representative: Title: <b>Sydney D' Souza</b> MEP Project Manager									
Action Codes : 1 - Approval 2 - Information 3 - Revert									
Status Codes : A - Approved B - Approved As Noted C - Not Approved									
<small>Correction or comments made relative to submittals during this review will require the Contractor from compliance with the requirements of the drawings and specifications. The check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents.</small>									
ENGINEER'S REPRESENTATIVE'S COMMENTS :									
<p>1. Approved As Noted</p> <p>2. Refer to our Comments marked on the attached sheet.</p> <p style="text-align: center;">23/5/16</p>									
ECG ENGINEERING CONSULTANTS GROUP				Response By: 			Response Date: 23/5/2016		
				Copy: ECG/Arabtec/Others					














Project:- 3Star Hotel @Al Barsha

Client:-M/s.Abdulla Saeed Amer Hamad Alneyadi

Consultant:- M/s. Engineering Consultant

Main Contractor:-M/s. Arabtech Costruction

Hvac Contractor:-M/s.Airtechnic A/C System

CONSULTANT	CLIENT	CONTRACTOR	MEP SUBCONTRACTOR		
					
<b>SUBMITTAL/TRANSMITTAL SHEET # 4745 Rev.01</b>					
Project Name: "Celestia" Serviced Hotel Apartments at Plot No. RA-38 at Residential City, Dubai World Central, Dubai, UAE (P071-DXB-2013)		Project No. D114			
		Date: 2/Aug/2017			
Submittal No.:	CD/114/SIGMA/MD-205115/975	Revision:	1		
Submittal Title: Prequalification for HVAC System Testing ,Adjusting & Balancing (Alternative)					
We are sending herewith under separate cover the drawings / documents / samples listed below.					
ITEM NO.	DWGS / SPECS/BOQ/REF.	DESCRIPTION	TYPE	COPIES	REMARKS
1	Division 15 - Mech Section 15050	Prequalification for HVAC System Testing ,Adjusting & Balancing (Alternative)	MD	3 Copies 2 Soft Copy	
<small>TYL = Shop Drawings, SM= Sample, GT= Guarantee, MD= Manufacturer's Data, CT= Certificates, TT= Test Results, OT= Other</small>					
Supplier / Manufacturer: M/S. Prime Technologies LLC					
We certify that the documents / materials submitted herewith have been reviewed in detail and are in strict conformance with the contract drawings and specifications except as otherwise stated.					
Main Contractor (Name): Khaled Nofal - Project Manager		Signature: 	Date: 02.08.2017	Rev'd By: 	Date: 02.08.2017
MEP Contractor (Name): Hassan Hassan - Project Manager (MEP)		Signature: 	Date: 2-08-17	Rev'd By: 	Date: 02.08.2017
Resident Engineer Review Comments			CONSULTANT DECISION		
<p>Refer to attached comments &amp; fully comply.</p> <p>Verify method statement to follow by Contractor requirements.</p> <p>Provide details for balance major equipments T.C including for heat exchanger connecting methods.</p> <p>For vapour, provide details with some pumps &amp; panels etc.</p> <p>Clarify for balancing T.C req. to be in accordance with specifications assigned to same.</p>			<input type="checkbox"/> 'A' APPROVED <input checked="" type="checkbox"/> 'B' APPROVED As NOTED <input type="checkbox"/> 'C' NOT APPROVED <input type="checkbox"/> 'D' NOT REQUIRED		
Resident Engineer (Name): Ramesh Munlyappa		Signature: 	Date: 16 AUG 2017	Rev'd By: 	Date: 16 AUG 2017
<small>Corrections or comments made relative to submittals during this review do not relieve the contractor from compliance with the requirements of the Contract. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and certifying all quantities and dimensions, selecting fabrication processes and techniques of construction, coordinating his work with that of other specialist engineering his work in a safe and satisfactory manner.</small>					
Copy to: Head Office					
  					
Sheet No. 1 of 1					



Project: - Celestia Serviced Hotel Aparments

Client:- Damac

Consultant:- M/s. Engineering Consortium

Main Contractor: - M/s. Civilco Civil Engineering

Hvac Contractor:-M/s. SIGMA ENGINEERING LLC

		ABU DHABI NATIONAL OIL COMPANY (ADNOC) RUWAI'S HOUSING COMPLEX EXPANSION - PHASE IV CONSTRUCTION OF VILLAS - PACKAGE-03 PROJECT No. 7010 AGREEMENT No.147010C11			
DRAWING/DOCUMENT TRANSMITTAL FORM					
Transmittal No.: 8487		Date: 08.04.2017		Resp. By: M/s. ADNOC	
From: Dhabi Contracting LLC		To: M/s. ADNOC		Attn.: Project Manager	
Document Class		<input type="checkbox"/> First Submission <input checked="" type="checkbox"/> Second Submission <input type="checkbox"/> Further Submission			
Previous DTF Ref: - 8286		Date: 16.03.2017		Category: C	
Sr.No.		Document No.		Description	
01		DC/7010C11/PQD-M-315		Pre-qualification Document for Commissioning Management and Testing, Adjusting & Balancing Services (For Albanian International) Supplier: M/s. Prime Technologies	
				Rev. 01	
				Copies 1-1	
				Approval Category B	
<b>CONTRACTOR REVIEW CHECK LIST</b> <input type="checkbox"/> Architectural <input type="checkbox"/> Civil / Structural <input checked="" type="checkbox"/> Mechanical <input type="checkbox"/> Electrical <input type="checkbox"/> Plumbing					
THIS SUBMITTAL INTENDED FOR <input checked="" type="checkbox"/> APPROVAL / COMMENTS <input type="checkbox"/> AS PER YOUR REQUEST					
For Dhabi Contracting LLC. Ahmed Mansour Project Director					
For COMPANY: <input checked="" type="checkbox"/> Accepted <input type="checkbox"/> Accepted with Comments <input type="checkbox"/> Not Accepted					
Comments: Answer Sidique M/s Prime					
1) As commented earlier, Abu Dhabi commercial license of the proposed Supplier / 3 <sup>rd</sup> Party T&C agency is not available, CONTRACTOR to provide the same. 2) As commented earlier, provide a copy of registration with COMPANY or proof of application of registration with COMPANY for the proposed 3 <sup>rd</sup> party T&C agency. 3) CONTRACTOR to indicate the description of the DTF clearly on submittal cover sheet that the proposal is for 3 <sup>rd</sup> party T&C specialist agency for all MEP services as per PROJECT Specification Section 15950 (except SNG). 4) CONTRACTOR shall provide substantiation for proposing this PQ as an alternative Supplier / 3 <sup>rd</sup> Party T&C agency, since the same had been approved earlier via DTF # 5793 dated 3 <sup>rd</sup> July 2016. 5) Comply with listed items as per company PQ requirements.					
Mr. Ahmed M. Salem Al Masoori		Project Manager		19 APR 2017	
NAME		DESIGNATION		DATE	
PCD-QSC-FMT-055		REV 0		15 May 2014	





Project:- Ruwais Housing Complex –Villas  
Package - 03

Client:-M/s. Adnoc

Consultant: - M/s. Adnoc

Main Contractor:-M/s. Dhabi Contracting

Hvac Contractor:-M/s. Al Bonian International

The Employer: 		The Engineer: 		The Contractor: 		MEP Contractor: 	
(P45) - DEVELOPMENT OF WAREHOUSE & ASSOCIATED FACILITY FOR M/S. DAFZA ON PLOT W-388 IN DAFZ, DUBAI, U.A.E.							
SUB-CONTRACTOR APPROVAL SUBMITTAL				Ref. No.: P41/WH/MEP/SSA/0000			
				Date: 12.3.2017			
Main Contractor: BELHASA ENGINEERING & CONTRACTING COLC.		MEP Contractor: IEMSC CO.L.L.C.		Project Manager: S.A. Pinto			
Signature & Date: 12/3/17		Signature: S.A. Pinto					
WE REQUEST APPROVAL OF THE FOLLOWING SUBCONTRACTOR: <input type="checkbox"/> Architectural <input type="checkbox"/> Civil/Structural <input checked="" type="checkbox"/> Mechanical <input type="checkbox"/> Electrical <input type="checkbox"/> Other							
Name of Sub-Contractor: PRIME TECHNOLOGIES				Specified <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
Nature of Work: Pre-Qualification of M/s. Prime Technologies				Spec. Ref. <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
Scope: PRB - QUALIFICATION DOCUMENTS				BOQ Ref. _____ Page _____			
Attachments:				<input checked="" type="checkbox"/> General Information <input checked="" type="checkbox"/> Test Disciplines <input checked="" type="checkbox"/> Quality Policy <input checked="" type="checkbox"/> Location Map <input checked="" type="checkbox"/> Organization & Resources <input checked="" type="checkbox"/> Completed Projects <input checked="" type="checkbox"/> Financial Information <input checked="" type="checkbox"/> Hard copy (4 Sets) <input checked="" type="checkbox"/> Soft copy - 1			
CONSULTANT'S COMMENTS: * Provide project specification, with compliance statement * The submitted forms shall include all the measurements to be taken and their expected values with upper and lower limits or error percentages if applicable							
STATUS: <input type="checkbox"/> Approved with No Objection <input checked="" type="checkbox"/> Approved with Comments <input type="checkbox"/> Resident as Noted							
Al Gurg Consultant Resident Engineer's Signature: 18/3/17		Date: 19 APR 2017		2:20 pm		JOB-220	
M/s DAFZA Comments: As Commented by Consultant							
M/s DAFZA Representative Signature: 19/4/17		Date: 19 APR 2017		19/4/17			
* 12 MAR 2017 3:15 pm * subject to client acceptance. * End user requirement sent to early to be							

Project: - Warehouse & Associated Facility-Dafza

Client:- Dubai Airport Free Zone

Consultant: - M/s. Al Gurg Engineer's

Main Contractor: - M/s. Belhasa Contractor

Hvac Contractor:-M/s. IEMSC.LLC

